


Pluto Safety PLC

With dynamic safety concept.

Pluto/Gateway/Encoder

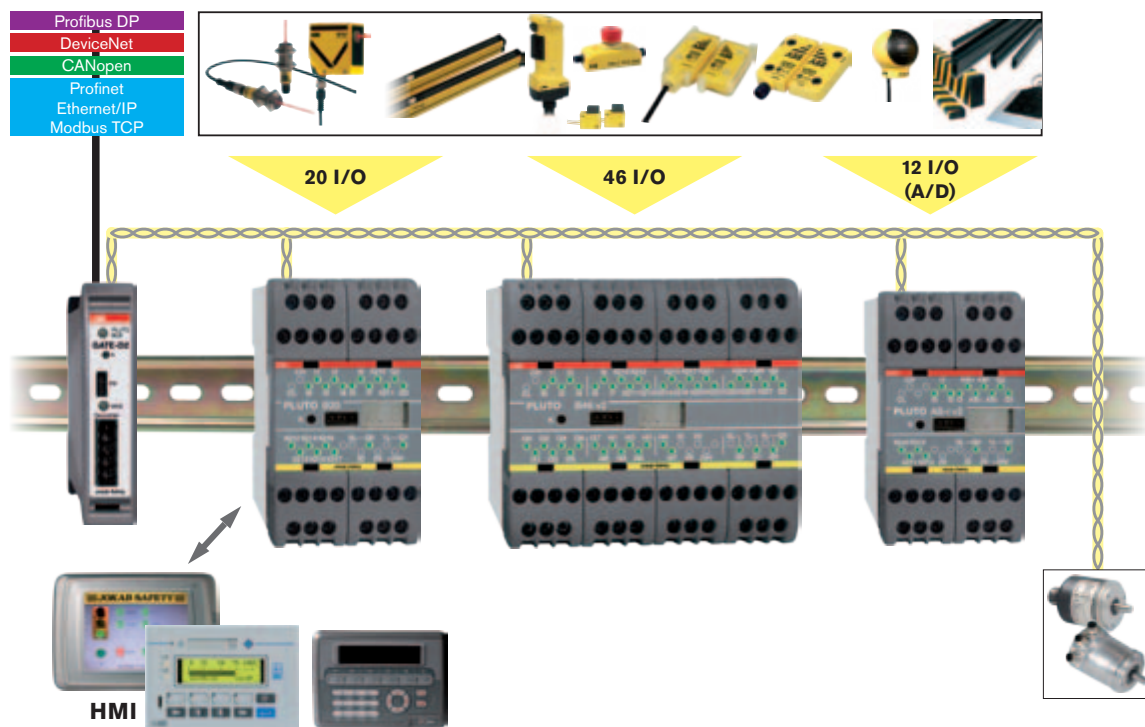

Why you should use the Pluto safety PLC	2:2
Pluto safety PLC	2:6
▪ Pluto without databus	2:8
▪ Pluto with databus	2:12
▪ Certification	2:15
▪ Example – Robot cell with Pluto	2:16
Pluto gateway	
▪ Gate P2-Profibus DP	2:24
▪ Gate D2-DeviceNet	2:26
▪ Gate C2-CANOpen	2:28
▪ Gate E2-Profinet, Ethernet/IP, Modbus TCP	2:30
Safe Encoder	2:32

Descriptions and examples in this book show how the products work and can be used. This does not mean that they can meet the requirements for all types of machines and processes. The purchaser/user is responsible for ensuring that the product is installed and used in accordance with the applicable regulations and standards. We reserve the right to make changes in products and product sheets without previous notice. For the latest updates, refer to www.abb.com/lowvoltage. 2012.

Why you should have Pluto safety PLC's.


– for simplifying the design of and changes to safety systems!

Pluto is an "All-Master" safety PLC concept, that simplifies the design of safety systems and achieves the highest safety level PL e according to EN ISO 13849-1 and SIL 3 according to EN 62061 and EN 61508. The key difference between Pluto and conventional safety PLC's is that there is no "Master-Slave" relationship between the control units connected to the safety bus. Each Pluto is a 'Master' unit and can see the other Plutos' inputs and outputs, and can thereby make decisions about its own safety environment.



This concept enables simple communication, programming and changes to the safety system. With the use of a 'Gateway' device, a Pluto can communicate with other bus systems and thereby form part of a larger network. Gateway units are available for several different bus systems, such as Profibus, CanOpen, DeviceNet, Profinet, Ethernet/IP and Modbus TCP. With a Pluto AS-i, both safety slaves and standard slaves can be handled.

Pluto offers an economic solution for both single machines and for major machine systems.

Our solution with All-Master

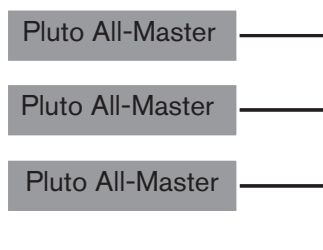


Traditional safety PLC

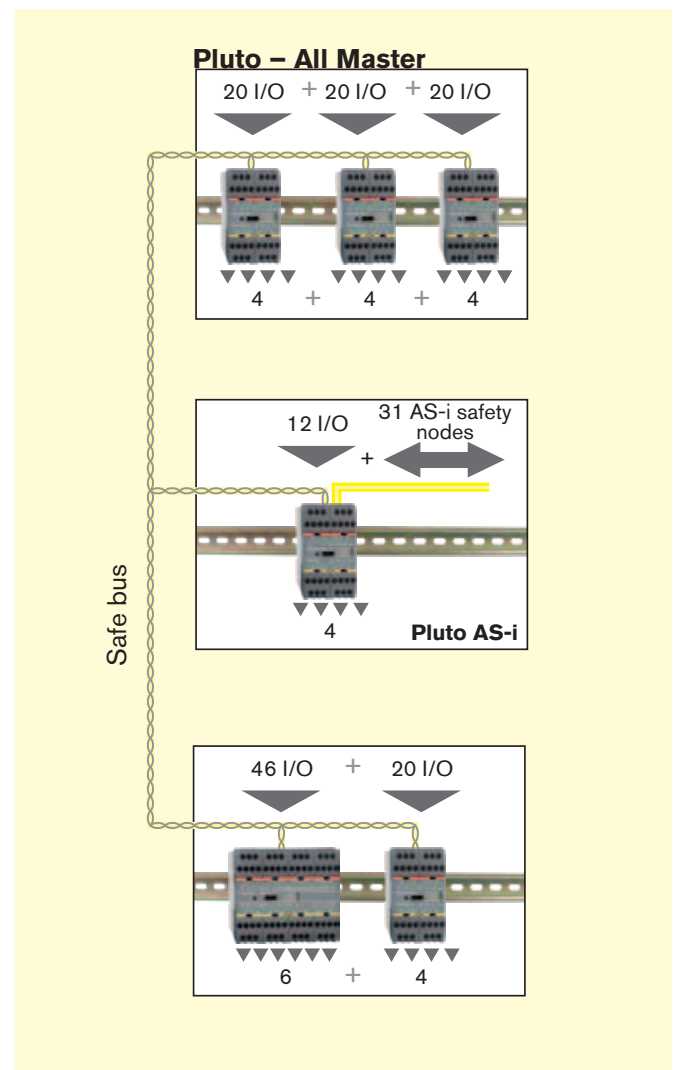

– to supervise safety devices!



Light beams




Light grids/curtains



3-position
devices



Sensors/
switches




Two-hand
controls



Emergency
stops



Strips



Mats


Most safety devices on the market can be connected directly to Pluto units. By using dynamic signals with sensors from ABB Jokab Safety only one input is needed to achieve the highest level of safety, compared to two inputs for other manufacturers' PLCs. It is also possible to connect up to 10 sensors in series to a single input on Pluto and still achieve the highest level of safety. For example non-contact Eden

sensors, Spot light beams and Tina emergency stop buttons can all be connected in series to a single Pluto input. Even mechanical switches can be connected to the 'dynamic' safety circuit using ABB Jokab Safety's various Tina adaptors. Pluto also has IO connections that can be used as both inputs and outputs.

– to save on inputs!

Dynamic signals


1–10 doors with one Eden per door
PL e

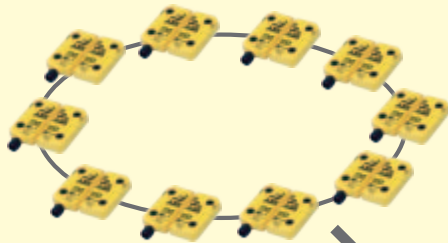

One input

Dynamic signals

1–10 sensors
PL e

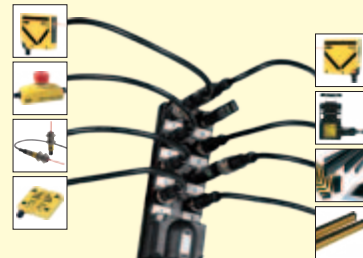

One input

Pluto

has inputs for static and dynamic sensors. Several sensors can be connected to one dynamic input in accordance with PL e.

One connection




Two inputs

IO connections

Pluto has IO connections that can be used in three ways:

- input
- output
- both input and output at the same time (e.g. for a reset button with lamp indication)

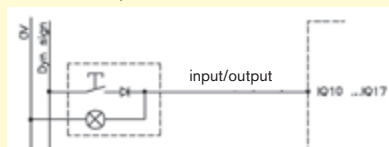


Static inputs (mechanical switches)

2 for each door = PL e




Pluto safety PLC – an overview

Pluto with a safety bus

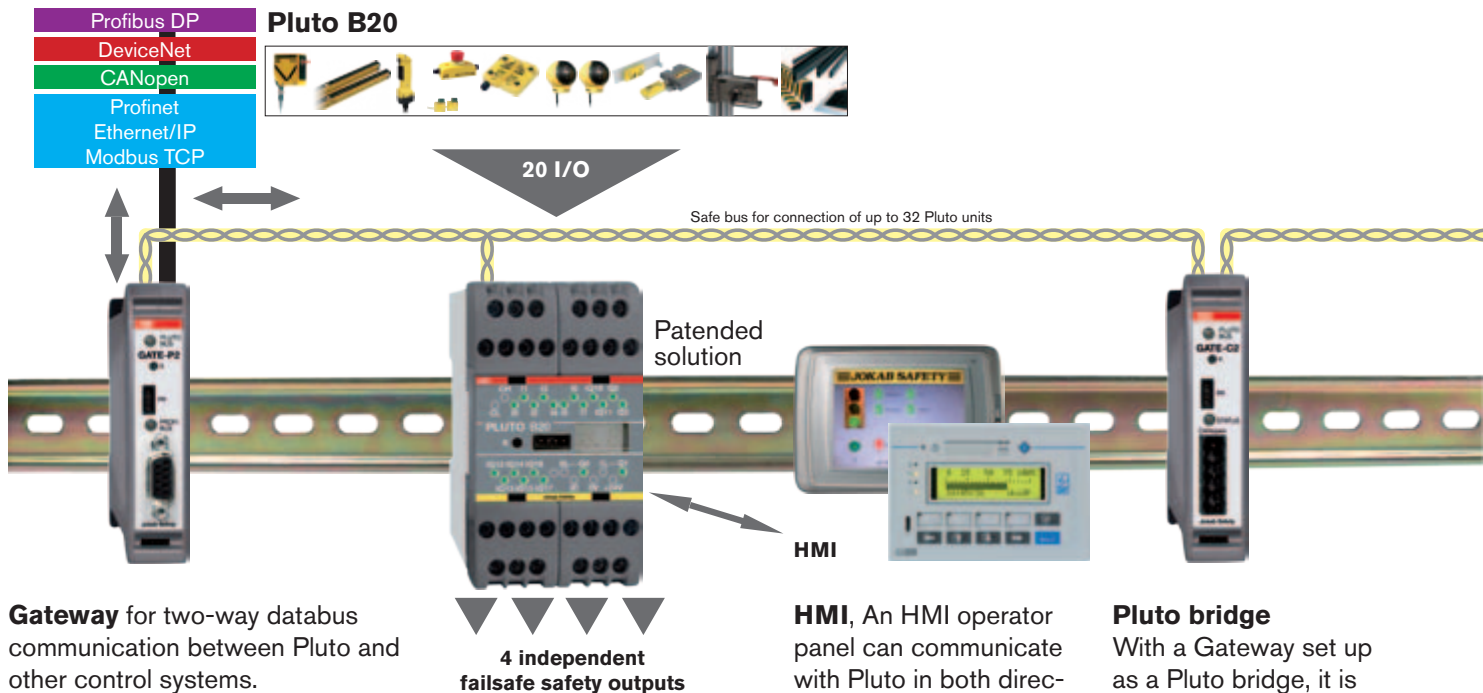

Pluto without a safety bus – Singel-Pluto

A single Pluto can be used as a fully programmable safety logic controller.

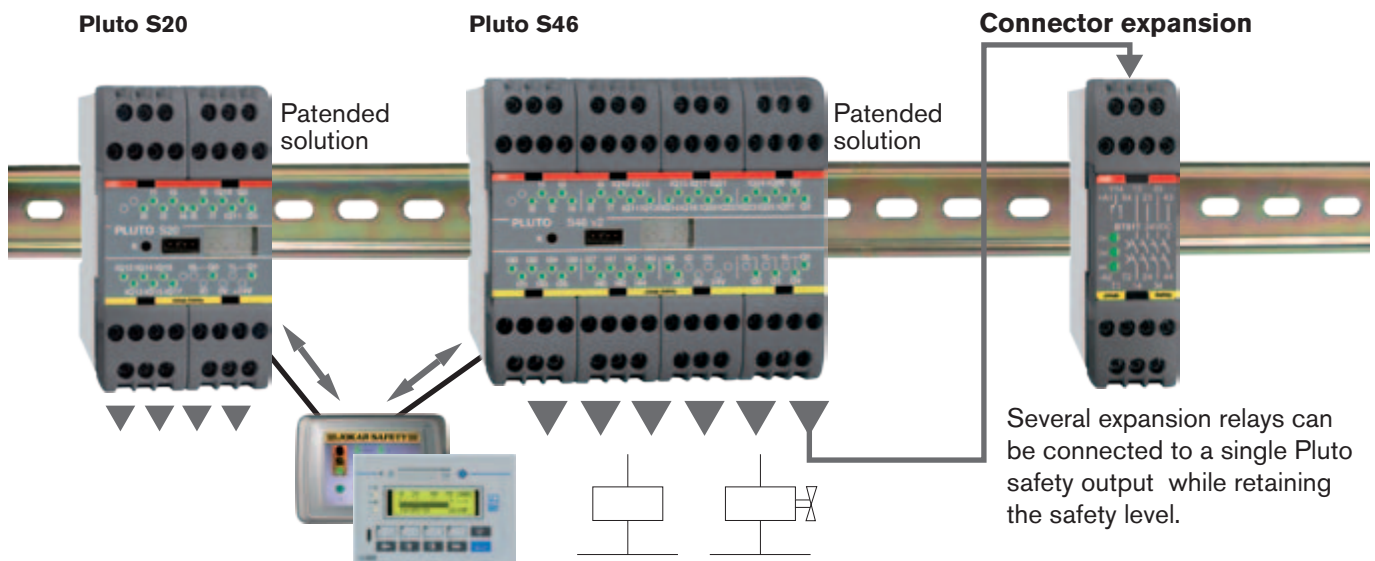

Pluto without a bus connection is available in two sizes, with 20 and 46 I/O, the S20 and S46 respectively. In other words, they are similar to the equivalent versions with bus connections, the B20 and B46.

Pluto B46



46 I/O



6 independent
failsafe safety outputs

Patented
solution


Patented
solution



Absolute encoder.

8 single turn or multi turn absolute encoders can be connected directly to the safety bus.

Pluto AS-i



Safety Monitor/Master

12 I/O
(A/D)

31 AS-i safety slaves

4 independent
failsafe safety outputs

Approvals

EN 954-1, Category 4
EN ISO 13849-1, PL e
EN 61496-1, Type 4
EN 61508, SIL 3
EN ISO 62061, SIL 3
EN ISO 60204-1
EN 50178
EN ISO 574, Type IIIc



Pluto AS-i is an AS-i module which can be connected to a AS-i bus. It can either be AS-i master on the bus or work together with an AS-i master as monitor. It includes AS-i nodes, analogue and digital outputs, as well as safety outputs.

IDFIX - identifies Pluto

IDFIX is a identification circuit that is unique to each device on the Pluto bus. It includes an identification code and makes it possible to distribute a PLC program in the network. There are four different versions: R, RW, DATA and PROG. IDFIX PROG also has the current PLC program. If the Pluto PLC module needs to be replaced, all the information on this is held in memory at IDFIX.



Overview Pluto Safety-PLC

Model	S20	S46	A20	B16	B20	B46	AS-i	B42 AS-i
Number of I/O	20	46	20	16	20	46	12	42
Failsafe inputs	8	24	8	8	8	24	4	20
Failsafe inputs or non-failsafe outputs	8	8	8	8	8	8	4	16
Analog inputs	1	3	1	1	1	3	4	3
Failsafe relay outputs	2	4	2	-	2	4	2	4
Failsafe transistor outputs	2	2	2	-	2	2	2	2
Pluto bus	-	-	●	●	●	●	●	●
Current monitoring	-	-	2	-	-	-	-	-
Dimensions (b x h x d) mm	45 x 84 x 118	90 x 84 x 118	45 x 84 x 118	45 x 84 x 118	45 x 84 x 118	90 x 84 x 118	45 x 84 x 118	90 x 84 x 118
Supply voltage	24VDC	24VDC	24VDC	24VDC	24VDC	24VDC	24VDC	24VDC

Safety PLC

Pluto

Approvals:

TÜV Rheinland  

Control of:

Safety products in dynamic and static circuits

Electrically controlled actuators such as contactors, valves, motors

Indicators and buttons

Features:

A Safety-PLC for each system part

Dispersed constructions of machines


Great flexibility

Up to 10 sensors in series connected to one input

Software Pluto Manager free of charge

Handles conventional circuit breakers as well as dynamical sensors

Custom made safety bus

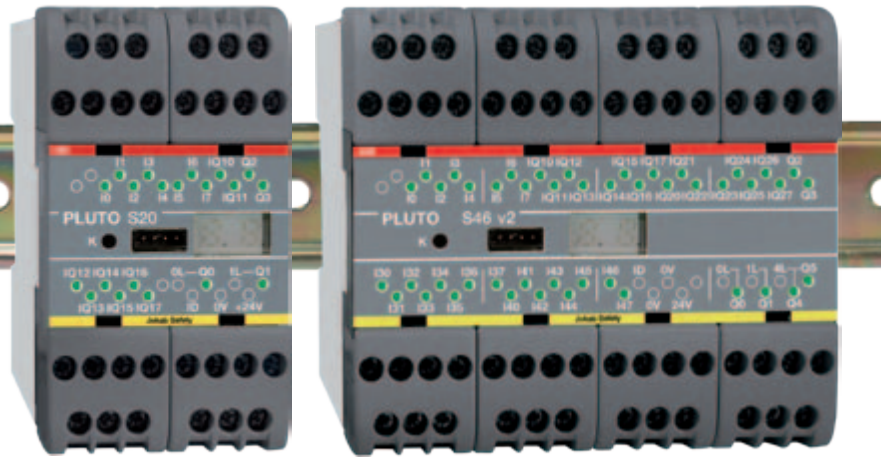

Pluto Safety PLC facilitates the design of your safety systems

Pluto is an All-Master system for dynamic and static safety circuits where inputs and other information are shared over the bus. Multiple safety sensors can be connected to a single input and still achieve the highest level of safety. Pluto has inputs suited for every safety product on the market, and each input function is configured in the accompanying software Pluto Manager.

Besides failsafe inputs (I) Pluto has a number of failsafe relay and transistor outputs (Q). On every Pluto unit there is also a possibility of using a number of terminals as failsafe inputs, non-failsafe outputs or both in and output simultaneously (IQ). The characteristics of the terminals are easily configured in Pluto Manager.

Safety in large and small systems


Pluto models without bus communication are stand alone units and are therefore perfectly suited for smaller systems that do not require communication with other Pluto units or gateways. Pluto models with bus communication can be connected to the Pluto bus where up to 32 Pluto units can interact and control large as well as small safety systems. The fact that Pluto is an All-Master system means that each Pluto unit controls their outputs locally, while it is as easy to read other Pluto units' inputs as their own.

Specifically for Pluto A20 is that it is equipped with an analogue input for current measurement, which can be used for e.g. monitoring of muting lamps.

Pluto is primarily designed to satisfy the requirements of EU Machinery Directive (2006/42/EG) regarding safety in control systems, but the system can also be used in other areas as in the process industry, boiler plants etc which have similar requirements.

Technical info - Pluto

Dynamic signal

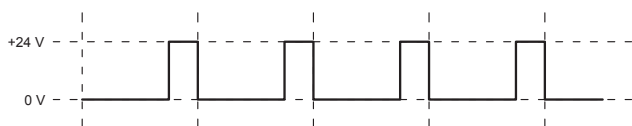


A dynamic signal makes it possible to achieve the highest level of safety with only one conductor. By transmitting a square wave and then evaluating the signal when it comes back to the controller you achieve the redundancy required. The signal is inverted once at each safety sensor (if the protection is OK) which makes it possible to detect short circuits across a sensor. When the signal switches between high (+24 V) and low (0V) it can be evaluated and tested about 200 times per second.

Pluto can generate three unique dynamic signals; A pulse, B pulse or C pulse. Short circuits between two different dynamic signals are detected whenever the signal that is created is different from the expected signal in Pluto. The kind of signal Pluto expects at the input terminal is determined in Pluto Manager (A, B or C pulse and if the signal should be inverted or not).

Static signal

Static signals (+24 V or 0 V) can be connected to all inputs on Pluto. The kind of signal Pluto expects at the input terminal is determined in Pluto Manager. To achieve a two-channel structure according to EN ISO 13849-1 you need two inputs.

OSSD-signal

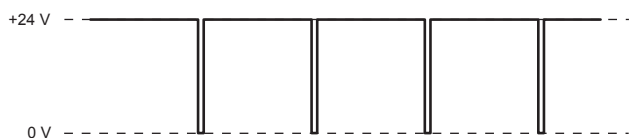

There are safety products with internal monitoring of dual OSSD signals (the device detects its own faults rather than Pluto doing this). From these devices, at least one of the two signals is connected to an I-input in Pluto, i.e. both signals must not be connected to the IQ-terminals. The terminal blocks are then configured in Pluto Manager to expect static inputs (OSSD signals are filtered internally in Pluto).

IQ – individual failsafe inputs and non-failsafe outputs

The IQ terminals can be used either as individual failsafe input or non-failsafe output (e.g. for indicator light or status signal). The terminal blocks can also be used as both input and output simultaneously, which is useful for example for push buttons (input) with indicator light (output). This function is designed primarily for reset buttons to reduce the number of used terminal blocks on the controller.

I - individual failsafe inputs

All inputs are individually failsafe as each input is connected separately to both processors in Pluto. In order to maintain the redundancy required for two-channel structure and the highest level of safety, the dynamic signal must be used. When using static signals, two inputs must be used to achieve two-channel structure. The expected signal to the terminals blocks is determined in Pluto Manager (static or dynamic signal).

Q - individual failsafe outputs

All Q outputs are individually safe and are independently programmable. There are both relay outputs and transistor outputs.

Transistor outputs (-24 VDC)

The transistor outputs are just like the relay outputs, that is individually safe and independently programmable. However, the transistor outputs are different from the relay outputs as the internal connection provides the nominal input voltage -24 VDC, which is primarily intended for controlling electromechanical components such as contactors and valves. As -24 VDC is a unique signal in the majority of electrical cabinets and the fact that the output is monitored by Pluto, short circuits with other potentials can be detected right away.

Pluto-bus

The Pluto-bus is a CAN-bus with its own safety protocol. The bus cable can be up to 600 m long at the minimum bus speed, and up to 150 m at 400 kb/s. The bus can be both extended and connected to other types of buses through gateways.

Pluto Manager and IDFIX

Pluto manager

The Pluto Manager is a freeware for fast, easy and safe programming of the PLC program for Pluto. The programming language used is ladder, which is supplemented with TÜV-approved function blocks for many common features. The software can also be used to configure Pluto's terminal blocks, e.g. to specify the IQ terminals that serve as inputs or outputs, and if the controller should expect a static or dynamic signal. Pluto Manager can be downloaded from www.abb.com/lowvoltage.

IDFIX


IDFIX is a identification circuit that is unique to each device on the Pluto bus. It includes an identification code and makes it possible to distribute a PLC program in the network. There are four different versions: R, RW, DATA and PROG. In addition to the identification code, DATA may also include safety codes from the AS-i nodes in an AS-i system. PROG includes the current PLC program and is used with single-Pluto for program distribution. IDFIX is connected between the input terminals ID and 0V.

Pluto without a safety bus

Single Pluto controls and monitors safety for local systems - large aswell as small systems




20/46 I/O

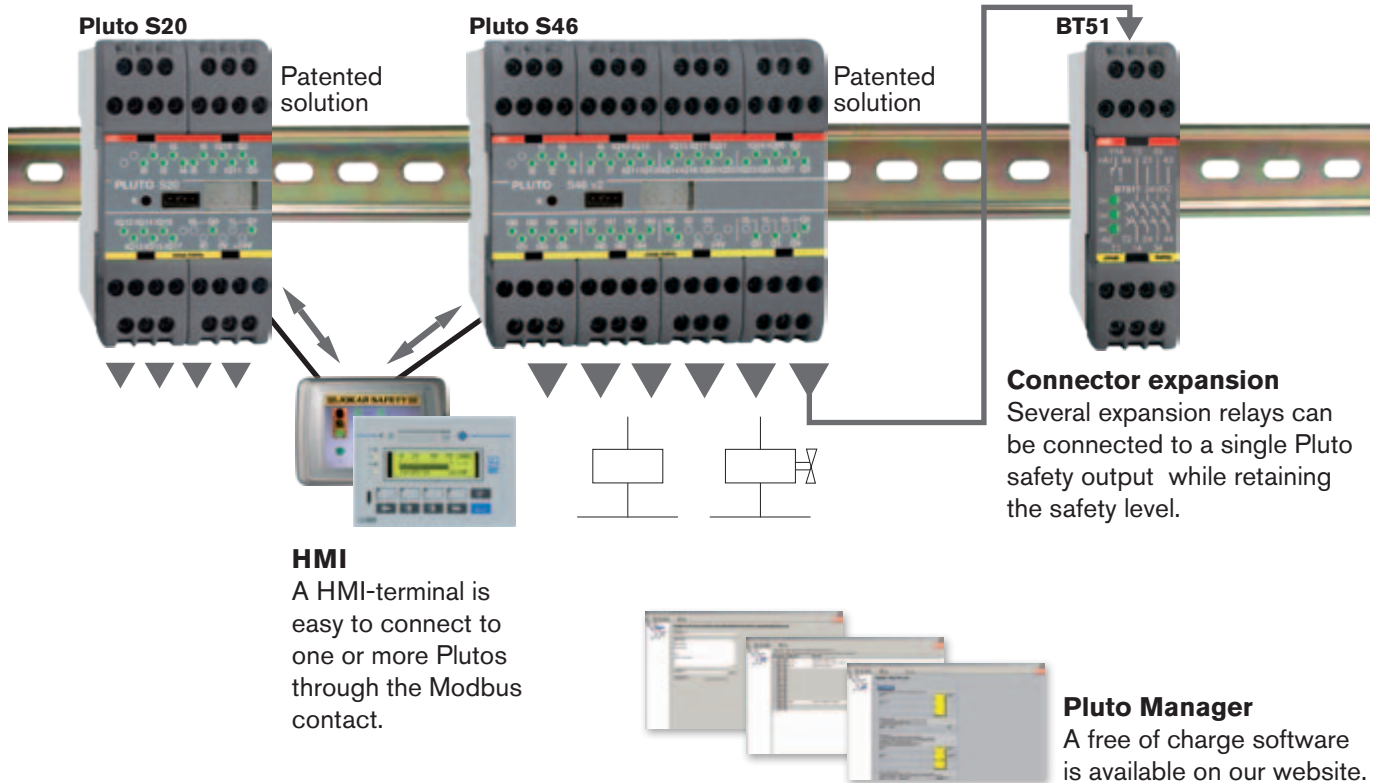

The Pluto S20 and Pluto S46 versions are safety PLC's that are designed for safety and protection products installed locally on a machine. With a wide range of connectivity options, a lot of protection is integrated into a PLC which in turn controls, for example, one or more safe outputs in a qualified manner without risking a dangerous situation.


Using an expansion relay, such as BT50, the number of safe outputs in Pluto can be expanded. The connection will then be made as shown in the figure. If IDFIX PROG is used for single-Pluto, there is the option of copying a PLC program via the identification circuit over to Pluto without having to connect a computer.

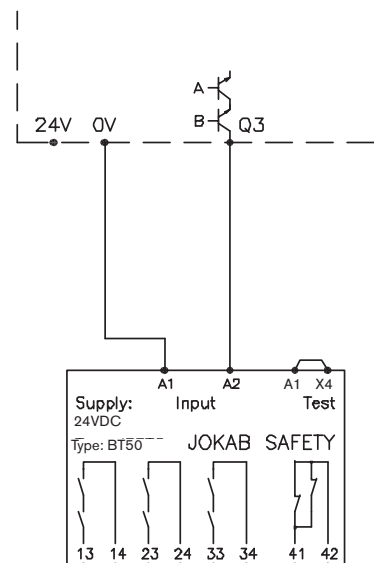



Connection example of a contact expansion with Pluto

Technical data - general	
Manufacturer:	ABB AB/Jokab Safety, Sweden
Colour:	Grey
Operating voltage:	24V DC $\pm 15\%$
Installation:	35 mm DIN rail
Electrical insulation:	Category II in accordance with IEC 61010-1
Level of safety: EN 954-1 EN ISO 13849-1 EN 61508 EN 62061	Kat. 4 PL e/kat. 4 SIL 3 SIL 3
PFH _o Relay output Transistor output	2,00×10 ⁻⁹ 1,50×10 ⁻⁹
Failsafe inputs I & IQ Type: Current at 24 V Max. overvoltage	+24 V (for PNP sensors), IQ also configurable as non-failsafe outputs 5.1 mA 27 V continuous
Safe outputs Q Q2–Q3: Output voltage tolerance Q0, Q1, (Q4, 5):	Transistor, –24VDC, 800 mA Supply voltage - 1,5 V at 800 mA Relay outputs AC-1: 250 V/1,5 A AC-15: 250 V/1,5 A DC-1: 50 V/1,5 A DC-13: 24 V/1,5 A
Non-failsafe outputs Q Type: Max. current/output:	Transistor +24V, PNP "open collector" also configurable as failsafe inputs 800 mA



Temperature Ambient temperature: Storage and transport:	–10°C to +50°C –25°C to +55°C
Response times Dyn. A or static input to relay output: Dyn. A or static input to transistor output: Dyn. B or Dyn. C input to relay output: Dyn. B or Dyn. C input to transistor output: Software setting "NoFilt".	<20.5 ms + program exec. time <16.5 ms + program exec. time <23 ms + program exec. time <19 ms + program exec. time 5 ms shorter response time on I & IQ inputs
Additional Response times Databus between Pluto units Databus between Pluto units on error	10 ms 10–40 ms
Enclosure classification Enclosure: Connection terminals:	IP 40, IEC 60 529 IP 20, IEC 60 529

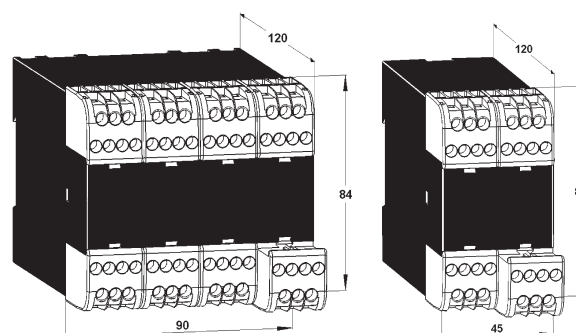

The terminal blocks are detachable without needing to disconnect the wiring. The units are assembled with a gap of at least 5 mm.

Technical data - type-specific		
		
	Pluto S20 20 I/O Non-Pluto safety bus	Pluto S46 46 I/O Non-Pluto safety bus
Article number/ordering data:	2TLA020070R0500	2TLA020070R1800
Failsafe inputs	8 (I0..I7)	24 (I0..I7, I30..37, I40..I47)
Failsafe inputs or non-failsafe outputs	8 (IQ10..IQ17) Max total load 2.5 A	16 (IQ10..IQ17) (IQ20..IQ27) Max. total load 2A
Analogue inputs	1 (I5) 0..27V	3 (I5) 0..27 V
Failsafe relay outputs	2 (Q0..Q1)	4 (Q0..Q1 & Q4..Q5)
Failsafe transistor outputs	2 (Q2..Q3)	2 (Q2..Q3)
Current monitoring	–	–
Pluto safety bus	–	–
Own current consumption	100...300 mA	100...500 mA
Recommended external fuse:	6 A	10A
Dimensions (w x h x d)	45 x 84 x 118 mm	90 x 84 x 118 mm

I/O Overview - Pluto without a safety bus

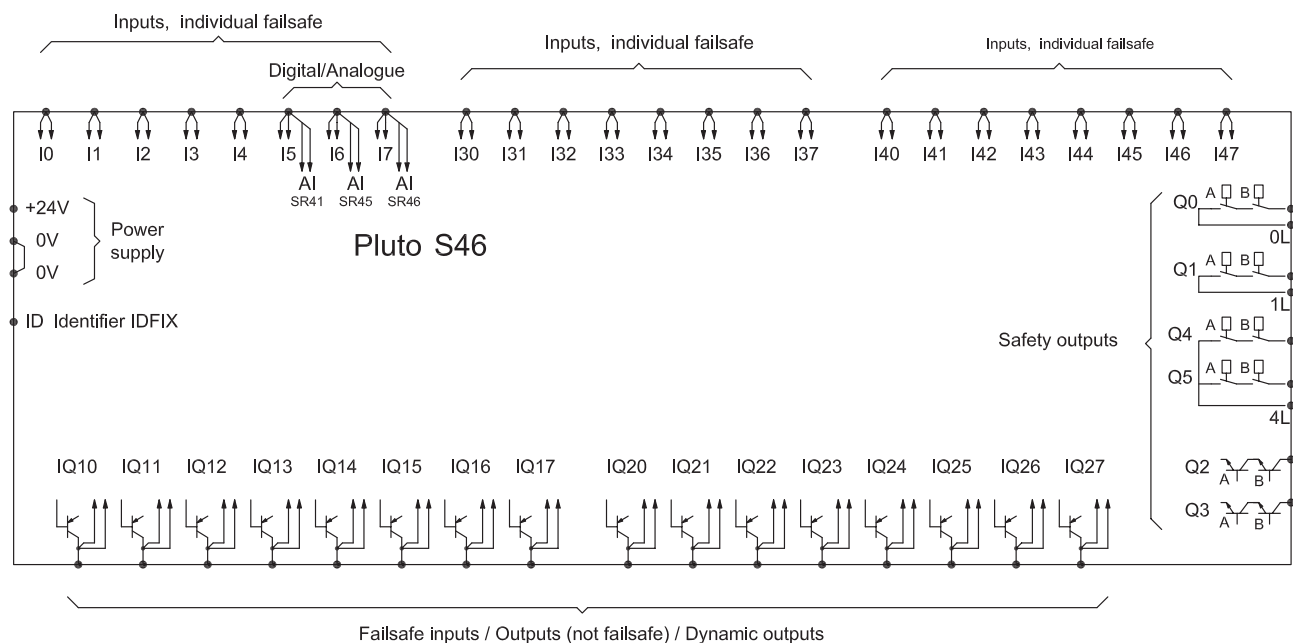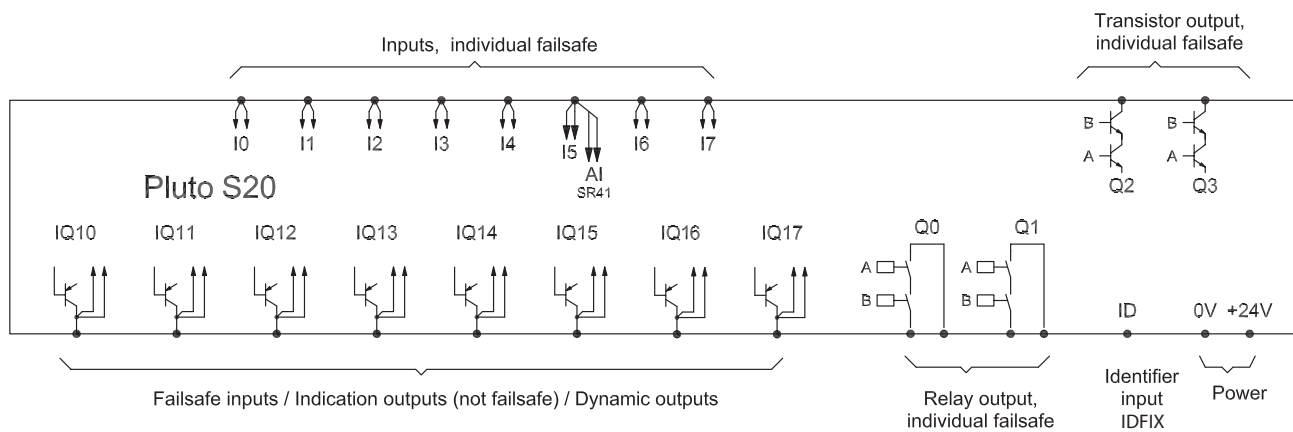


- ID: Connection for identifier, which has a unique ID number that can be read by the system.
- I.. Safety inputs (24 VDC) that are individually secure. This means that the highest level of safety can be achieved with only one input if ABB Jokab Safety dynamic safety components are used. Otherwise two inputs are required for each safety function.
- IQ.. I/O that can be used for safety inputs or signal outputs, e.g. to indicate or control functions that are not safety-related. For IQ.. as safety inputs, refer to I..
- Q0, Q1: Failsafe relay outputs that are individually failsafe and individually programmable.
- Q2, Q3: Failsafe transistor outputs (-24 VDC) that are individually failsafe and individually programmable. Intended for electro-mechanical components such as contactors and valves.
- Q4, Q5: Failsafe relay outputs with common potential that are individually failsafe and individually programmable.

Input connection

The system offers solutions for both single and two-channel safety devices. In order to monitor wiring short-circuits it is possible to use up to three different dynamic signals and static voltage (+24 V) to supply the inputs. The inputs are then programmed to only accept one of the signal types.


In a two-channel system both channels will be measured, using two different signals. The system will thereby be able to detect a short-circuit between the channels.

In a single channel system the dynamic signal is modified at each sensor. A short-circuit between the input and the output of the sensor will be detected at the Pluto input. PL e according to EN ISO 13849-1 can thus be achieved by using only one channel and one input.

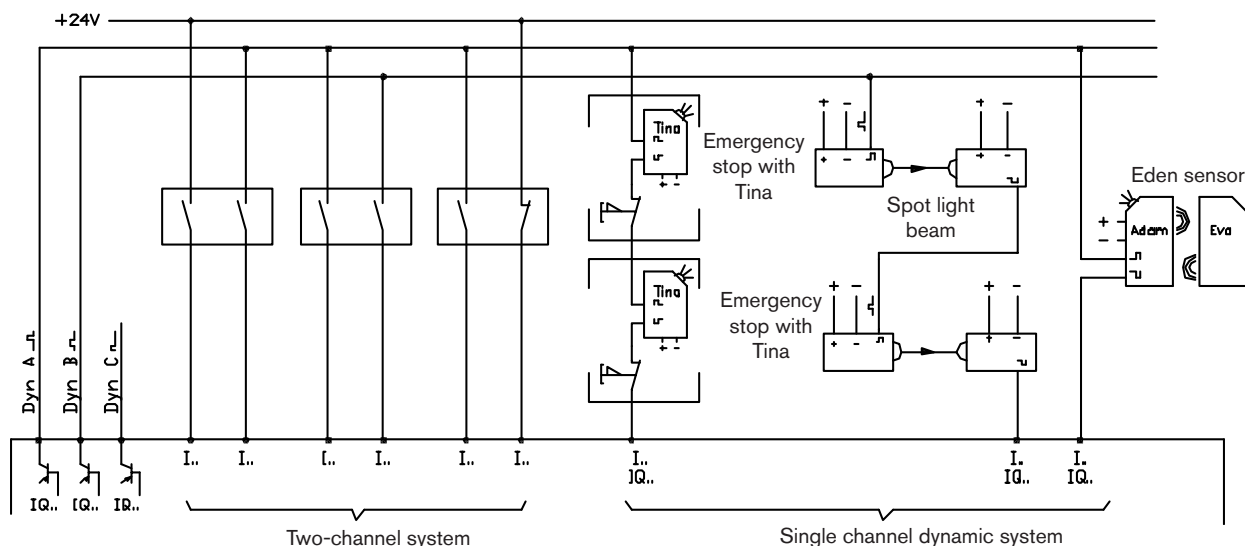

Input connection alternative in accordance with PL e EN ISO 13849-1.


Reset button that uses the combined input and output facility

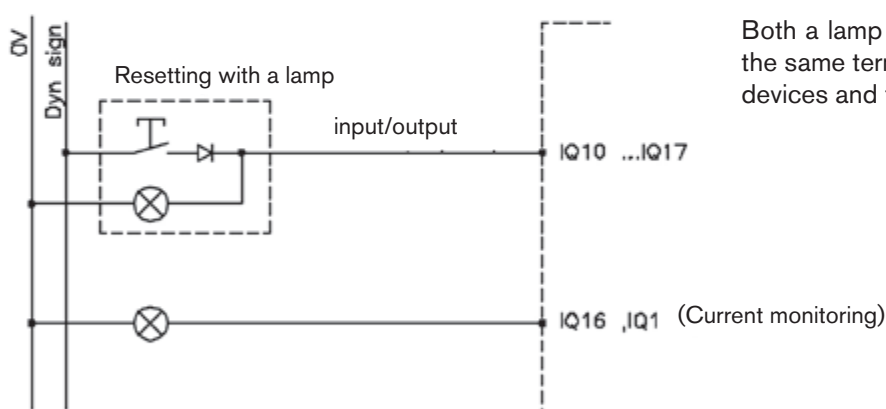

Both a lamp and a pushbutton can be connected to the same terminal. This function is for resetting safety devices and to reduce the number of I/Os used.

Pluto with a safety bus

Pluto models with a safety bus controls and monitors safety for dispersed systems
– large as well as small systems.

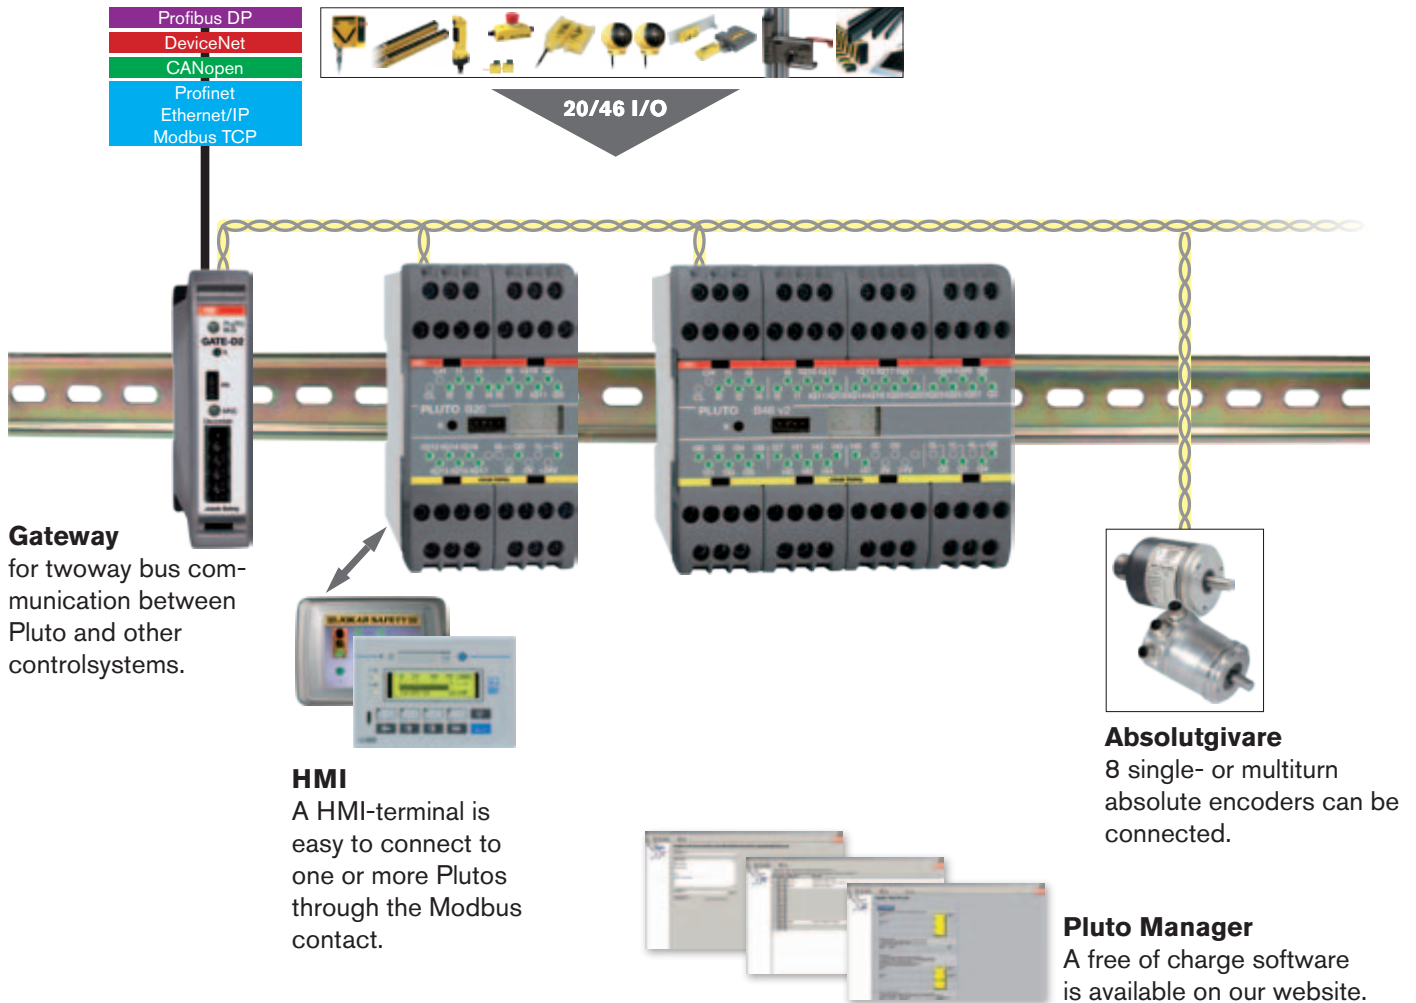



Pluto versions with bus have the same properties as single-Pluto unlike bus communication. With the help of the Pluto-bus networks can be created with multiple Plutos in interaction. Gateways can be connected to the Pluto bus for communication with other systems. The gateway models GATE D2 and C2 can also be used as an extension of the bus cable to extend the Pluto network. The fact that Pluto is an All-master system means that each Pluto device controls its outputs locally, while it is just as easy to read the inputs of other Pluto-units as it is to read its own. It is also easy to both read and write to global memory locations available across the Pluto bus. The PLC program is created using the Pluto Manager freeware and is distributed to all Pluto units. You can also connect speed and position sensors via the Pluto bus.

Current monitoring (Pluto A20 only)



Pluto A20 can monitor the current through the IQ16 and IQ17 outputs. The function is designed for, but not limited to, ensuring that the muting lamps are working. The hardware for current monitoring is not designed with individual redundancy, which means that the function must be used dynamically if it is to be used in a safety function. This means that the current must be read and evaluated both when the output is enabled and disabled.

Technical data - general	
Manufacturer:	ABB AB/Jokab Safety, Sweden
Colour:	Grey
Operating voltage:	24V DC $\pm 15\%$
Installation:	35 mm DIN rail
Electrical insulation:	Category II in accordance with IEC 61010-1
Safety level EN 954-1 EN ISO 13849-1 EN 61508 EN 62061	Kat. 4 PL e/kat. 4 SIL 3 SIL 3
PFH _D Relay output Transistor output	2,00×10 ⁻⁹ 1,50×10 ⁻⁹
Failsafe inputs I & IQ Type:	+24 V (for PNP sensors), IQ also configurable as non-failsafe outputs
Current at 24 V Max. overvoltage	5.1 mA 27 V continuous
Safe outputs Q Q2–Q3: Output voltage tolerance Q0, Q1, (Q4, 5):	Transistor, –24VDC, 800 mA Supply voltage – 1,5 V at 800 mA Relay outputs AC-1: 250 V/1,5 A AC-15: 250 V/1,5 A DC-1: 50 V/1,5 A DC-13: 24 V/1,5 A
Non-failsafe outputs Q Type: Max. current/output:	Transistor +24V, PNP "open collector" also configurable as failsafe inputs 800 mA


Pluto safety bus Max number of Pluto units on the databus: Databus type: Databus speeds: Databus cable length:	32 CAN 100, 125, 200, 250, 400, 500, 800, 1000 kb/s Up to 600 m, 150 m at 400 kb/s
Temperature Ambient temperature: Storage and transport:	–10°C to +50°C –25°C to +55°C
Response times Dyn. A or static input to relay output: Dyn. A or static input to transistor output: Dyn. B or Dyn. C input to relay output: Dyn. B or Dyn. C input to transistor output: Software setting "NoFilt".	<20.5 ms + program exec. time <16.5 ms + program exec. time <23 ms + program exec. time <19 ms + program exec. time 5 ms shorter response time on I & IQ inputs
Additional Response times Databus between Pluto units Databus between Pluto units on error	10 ms 10–40 ms
Enclosure classification Enclosure: Connection terminals:	IP 40, IEC 60 529 IP 20, IEC 60 529



The terminal blocks are detachable without needing to disconnect the wiring. The units are assembled with a gap of at least 5 mm.


Technical data - type-specific	   			
	Pluto A20 20 I/O <i>Current monitoring</i>	Pluto B16 16 I/O <i>Non-failsafe outputs</i>	Pluto B20 20 I/O	Pluto B46 46 I/O
Article number/ ordering data:	2TLA020070R0300	2TLA020070R0700	2TLA020070R0600	2TLA020070R1700
Failsafe inputs	8 (I0..I7)	8 (I0..I7)	8 (I0..I7)	24 (I0..I7, I30..37, I40..I47)
Failsafe inputs or non-failsafe outputs	8 (IQ10..IQ17) Max total load 2.5 A	8 (IQ10..IQ17) Max total load 2.5 A	8 (IQ10..IQ17) Max total load 2.5 A	16 (IQ10..IQ17) (IQ20..IQ27) Max. total load 2A
Analogue inputs	1 (I5) 0..27V	1 (I5) 0..27V	1 (I5) 0..27V	3 (I5) 0..27 V
Failsafe relay outputs	2 (Q0..Q1)	–	2 (Q0..Q1)	4 (Q0..Q1 & Q4..Q5)
Failsafe transistor outputs	2 (Q2..Q3)	–	2 (Q2..Q3)	2 (Q2..Q3)
Current monitoring	2(IQ16,IQ17) 0–1.0A $\pm 10\%$	–	–	–
Pluto safety bus	▪	▪	▪	▪
Own current consumption	100...300 mA	100...300 mA	100...300 mA	100...500 mA
Recommended external fuse:	6 A	6 A	6 A	10A
Dimensions (w x h x d)	45 x 84 x 118 mm	45 x 84 x 118 mm	45 x 84 x 118 mm	90 x 84 x 118 mm

I/O Overview - Pluto with a safety bus

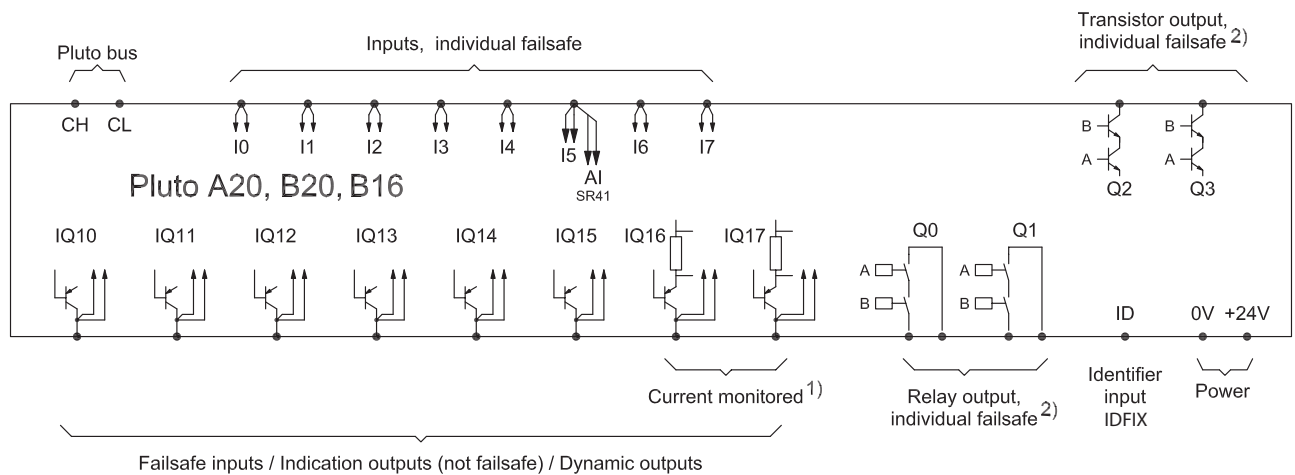

1) Current monitored only on A20

2) Not in B16

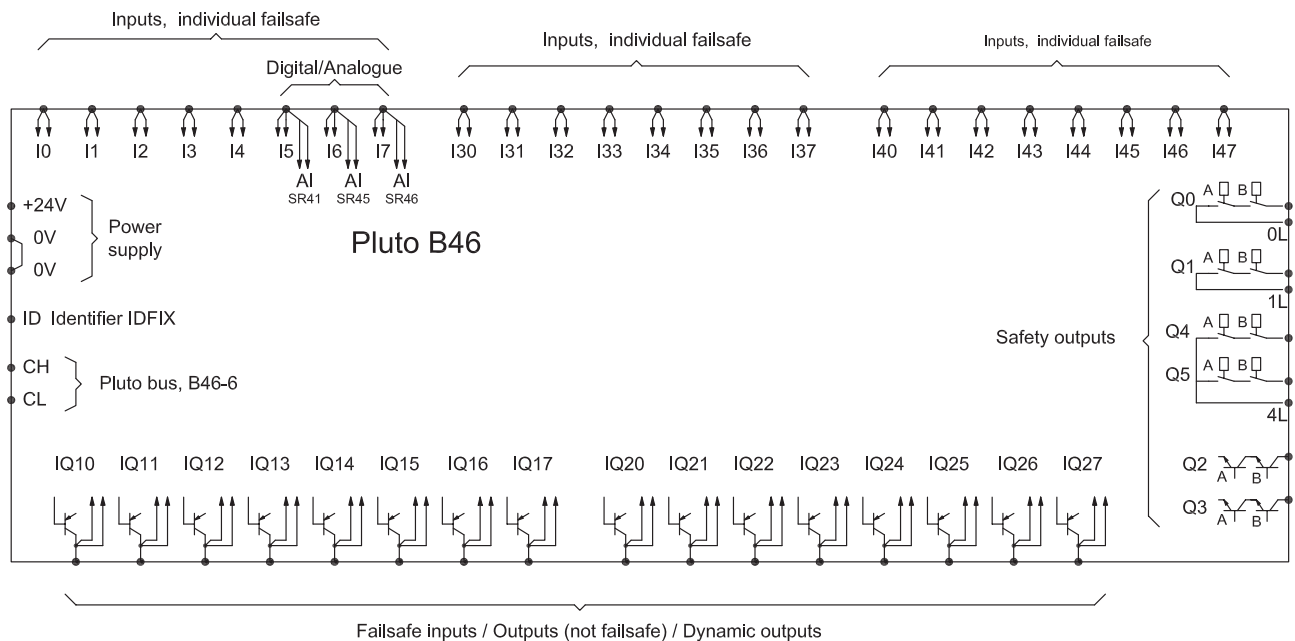

ID: Connection for identifier, which has a unique ID number that can be read by the system.

I.. Safety inputs (24 VDC) that are individually secure. This means that the highest level of safety can be achieved with only one input if ABB Jokab Safety dynamic safety components are used. Otherwise two inputs are required for each safety function.

IQ.. I/O that can be used for safety inputs or signal outputs, e.g. to indicate or control functions that are not safety-related. For IQ.. as safety inputs, refer to I..

Q0, Q1: Failsafe relay outputs that are individually failsafe and individually programmable.

Q2, Q3: Failsafe transistor outputs (-24 VDC) that are individually failsafe and individually programmable. Intended for electro-mechanical components such as contactors and valves.

Q4, Q5: Failsafe relay outputs with common potential that are individually failsafe and individually programmable.

TÜVRheinland®

**ZERTIFIKAT
CERTIFICATE**

EC Type-Examination Certificate
Reg.-No.: 01/205/5066/10

Product tested	Logic unit to ensure safety functions Safety PLC	Certificate holder	ABB AB Johab Safety Regimenten 3 213 76 Malmö Sweden
Type designation	Pluto	Manufacturer	see certificate holder
Code and standards forming the basis of testing	For certified Hardware and Software Versions see current "Version Release List". EN ISO 13049-1:2008 + AC:2008 EN 62061:2005 IEC 61508 Parts 1-7:1998 / 2000 EN 62004-1:2006 + A1:2009 (in extracts)		
Intended application	Safety related programmable electronic system for machinery and process industry applications. The Pluto PLC complies with the requirements of the relevant standards (Cat. 4 / PL, e acc. to EN ISO 13049-1, SIL CL 3 acc. to EN 62061 / IEC 61508, Type IEC of EN 574, Type 4 of EN 61489-1) and can be used in applications up to Cat. 4 / PL, e acc. to EN ISO 13049-1 and SIL 3 acc. to EN 62061 / IEC 61508.		
Specific requirements	The current "Version Release List" as well as the conditions defined in the Programming Manual, Safety Manual and the Operating Instructions must be considered.		
It is confirmed, that the product under test complies with the requirements for machines defined in Annex I of the EC Directive 2006/42/EC.			
This certificate is valid until 2015-11-19.			

Functional Safety Type Approved
FS

The test report no. 50666 157/05/10 dated 2010-11-19 is an integral part of this certificate.
The holder of a valid licence certificate for the product tested is authorized to affix the test mark shown opposite to products, which are identical with the product tested.

Berlin, 2010-11-19

Certified (R) to Machinery, NB 0035
Prof.-Ing. Eberhard Frey

TUV NORD

EG-Baumusterprüfbescheinigung
EC type-examination certificate

Registrier-Nr.
Registrier-Nr.:
44 206 11 300992 000

Zustimmendes Auftragsgebers
Customer's reference:

Auftraggeber
Date of order:
15.12.2010

Akzeptanz
File reference:
0000100002

Prüfbericht Nr.
Test report no.:
11 206 300992 000

Name und Anschrift des Auftragsgebers

ABB AB
Johab Safety
Varuforsvägen 11
434 39 Kungälv
Sweden

Customer's name and address

Erfüllt mit dem u. g. Produkt die Anforderungen des Anhangs I der Maschinenrichtlinie 2006/42/EG
The product described below meets the requirements of Annex I of the Directive 2006/42/EC
as a basis for the EC declaration of conformity.

Geprüft nach

Maschinenrichtlinie 2006/42/EG
Machinery Directive 2006/42/EC

Trüffert in accordance with

EN 61508:2001
EN 62061:2005
EN ISO 13049-1:2008
EN ISO 13049-2:2008
for URAX, E1 also:
EN 574:2008

Beschreibung des Produktes
(Details siehe Anlage 1)

Safe input drive for lock system "AS4 Safety at Work"

Description of product
(Details see annex 1)

Typenbezeichnung

URAX ...

Type Description

Serial-Nr.

siehe Anlage 1
see annex 1

Serial no.

Bezeichnung

EN 61508-1:EN 62061, SIL 3, PFD = 1.710⁻⁹
EN ISO 13049-1, pl "a"

Remark

Bitte beachten Sie auch die wesentlichen Hinweise
Please also pay attention to the information stated overhead

TUV NORD CERT GmbH
Zertifizierungsstelle / Certification body
Maschinen / Machinery
Bismarckstraße 104A / Industrial Estate, 42699
Solingen

Gültig bis / Valid to: 02.02.2016
Hameln, 02.02.2011

Langenscheidt AG + 42699 Solingen • Fax +49 (0)201 805 0130 • Fax +49 (0)201 805 0008 • Email: machinen@tue-nord.de

CSA INTERNATIONAL

Certificate of Compliance

Certificate: 1700378 **Master Contract:** 185438

Project: 1933310 **Date issued:** 2008/01/25

Issued to: Johab Safety AB
Regimenten 3
Malmö, 213 76
Sweden

The products listed below are eligible to bear the CSA Mark shown with adjacent indicators 'C' and 'US'

CSA
C US

Issued by: David Duggan, T.P.

Authorized by: Helene Villanueva
Operations Manager

Helen Villanueva


PRODUCTS

CLASS 1252-R1 PROCESS CONTROL EQUIPMENT - Certified to US Standards
CLASS 1252-R3 PROCESS CONTROL EQUIPMENT - Components
CLASS 1252-R3 PROCESS CONTROL EQUIPMENT - Certified to US Standards
CLASS 1211-07 INDUSTRIAL CONTROL EQUIPMENT - Miscellaneous Apparatus

Component type: Programmable Logic Controller, permanently installed rail mounted, Models: PLUTO A30, PLUTO I20, PLUTO S30, PLUTO A16, PLUTO B16, PLUTO B16-6, PLUTO S16-6 and PLUTO AS-4, rated output: 24Vdc, 5A (max), rated output: 24Vdc, 800mA 2-3A max total load all outputs (R210-R217) (R230-72) and 250Vvac, 1.5A (R24-Q1-R24-Q5), -24Vdc, 800mA (R24-Q3), 0P40, 0P70 terminals.

The 'C' and 'US' indicators adjacent to the CSA Mark signify that the product has been evaluated to the applicable CSA and UL/ETL Standards, for use in Canada and the U.S., respectively. The 'C' indicator includes products eligible to bear the NRTL, UL, or ETL Mark, while the 'US' indicator includes products eligible to bear the ETL Mark, only. The 'C' and 'US' indicators are not applicable to products that are not certified to the applicable CSA and UL/ETL Standards. For more information, please refer to the CSA and UL/ETL Standards, or contact the issuing body for more information.

Robot cell with Pluto

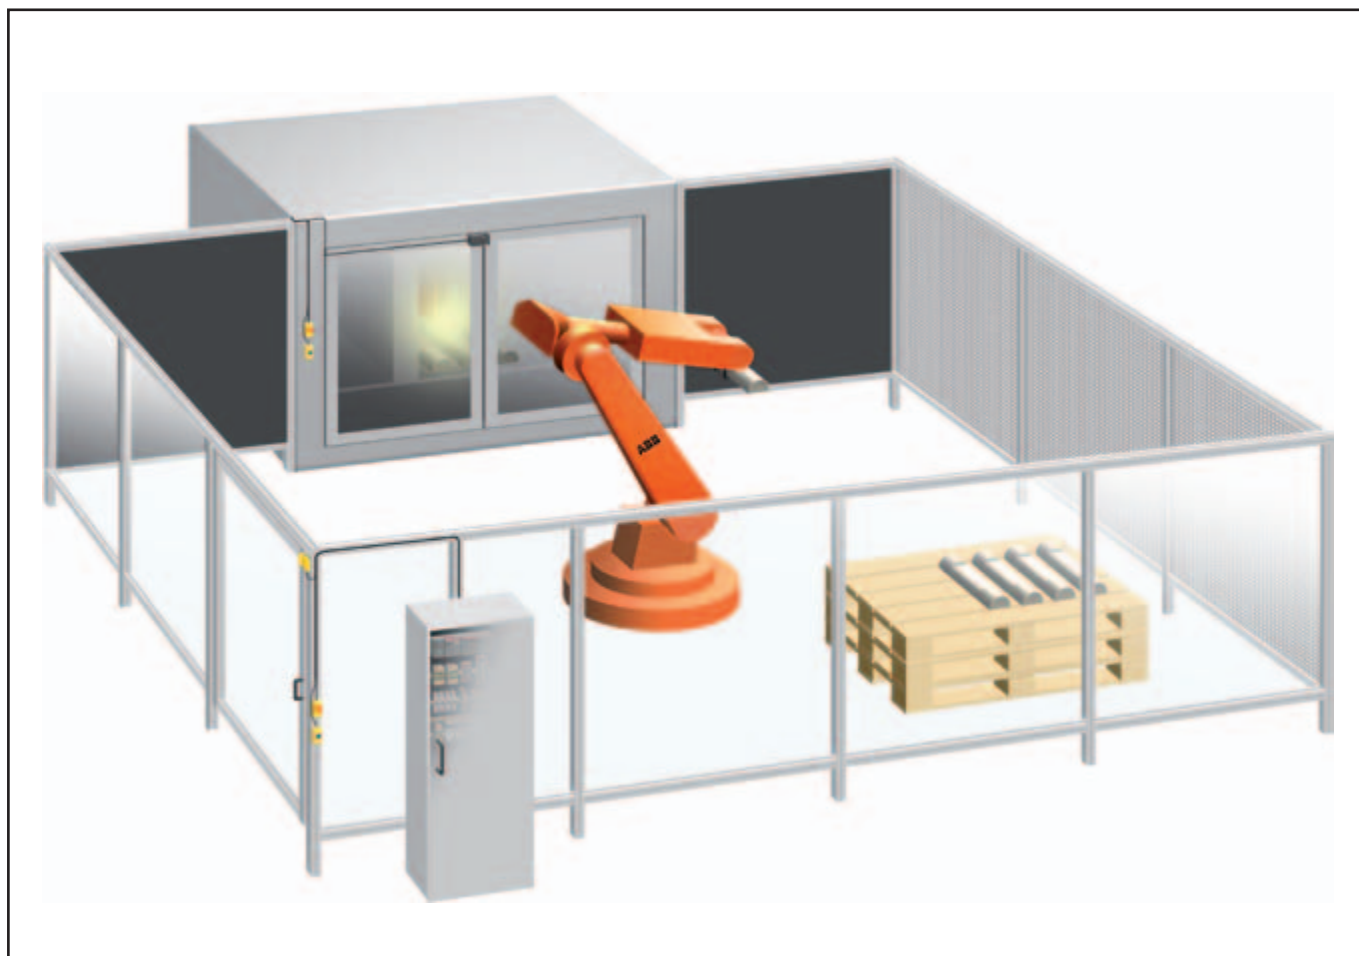



Description:

The example describes a processing machine served by a robot. The machine safety system consists of one (Pluto 1) to which all protection has been connected. The robot has been equipped with a (Pluto 0) to which the cell protection has been connected. The Pluto for the machine has been connected via a databus cable to the robot's Pluto so that common functions, such as emergency stop, can be used by the whole cell.

Function:

Emergency stop takes priority and will stop both the machine and the robot. The machine hatch acts as the zone divider, when the hatch is closed the machine forms one zone and the robot another zone. When the machine hatch is open, both the machine and the robot belong to the same zone. If the door is opened when the machine hatch is open, the machine and the robot will both stop, but if the machine hatch is closed, only the robot will be stopped. After the door has been opened, the system must be reset by means of the reset button on the outside of the door. Emergency stop is reset when the pressed-in button is pulled out. NOTE. The cell operating cycle must not however start immediately on resetting the emergency stop or the door.

Electrical connections

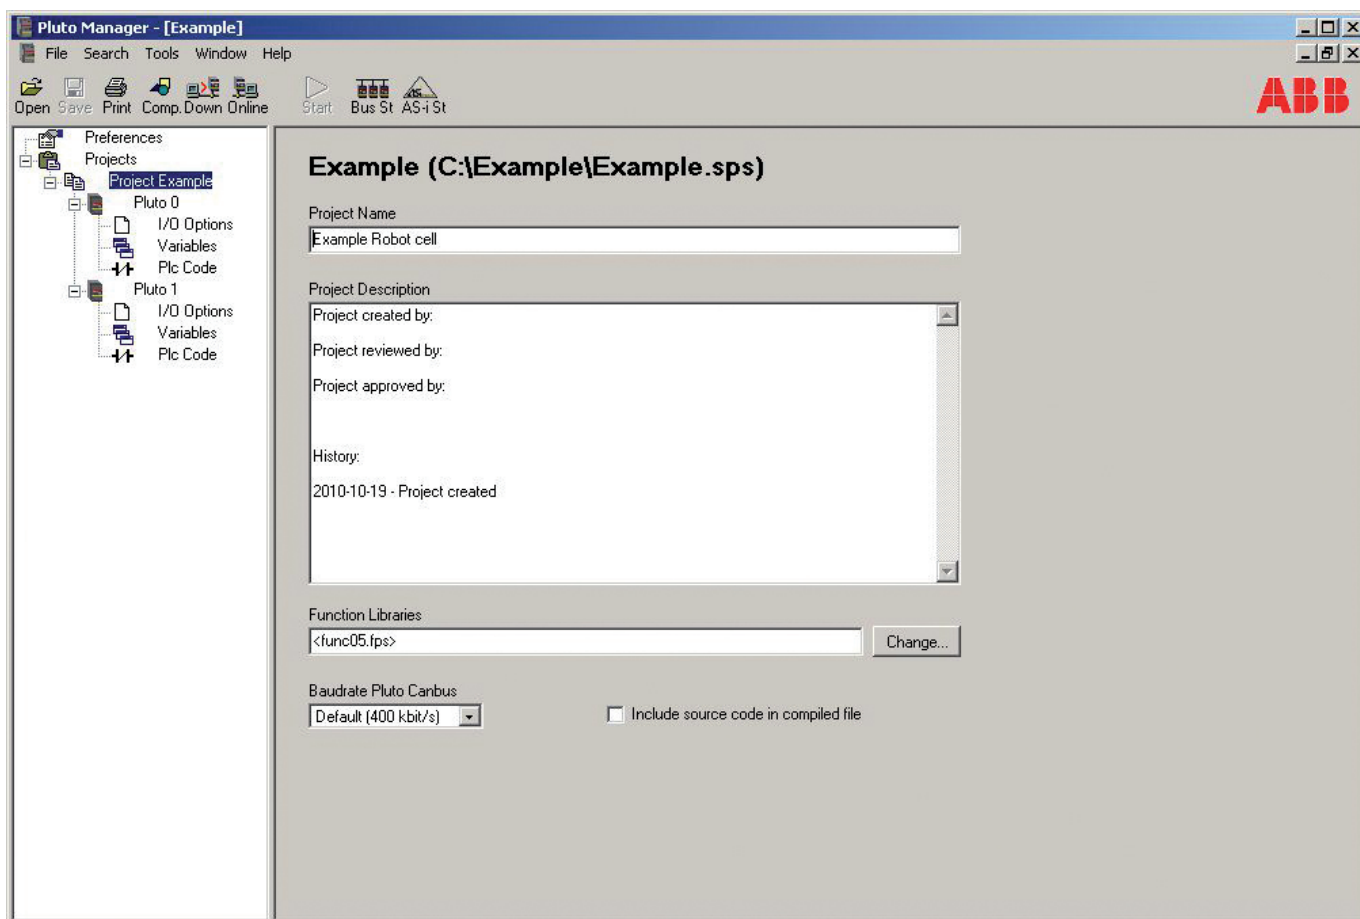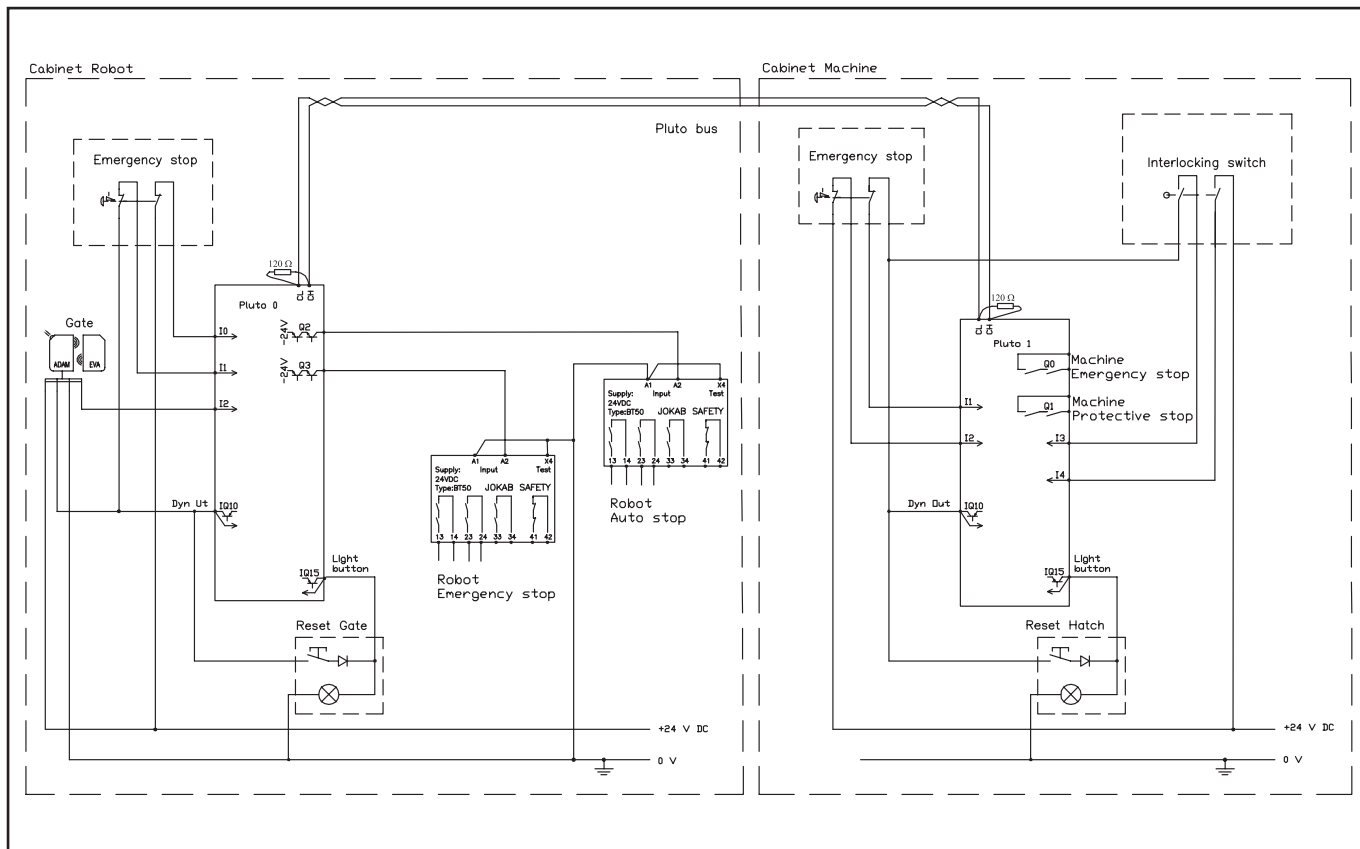

Pluto 0 settings – Robot cabinet




Pluto 0

I0.0=P0_ES1_Ch1
 I0.1=P0_ES1_Ch2
 I0.2=P0_Eden1
 I0.15=P0_LB1_In
 Q0.2=P0_AS_OK
 Q0.3=P0_ES
 GM0.0=P0_ES_OK

;Emergency stop 1 channel 1 - Static
 ;Emergency stop 1 channel 2 - Dynamic A non-inverted
 ;Door Eden sensor - Dynamic A
 ;Reset Door - Light button input - Dynamic A
 ;Robot auto stop - Expansion BT50 relay
 ;Robot emergency stop - Expansion BT50 relay
 ;Emergency stop OK in Pluto 0

Pluto 1 settings – Machine cabinet

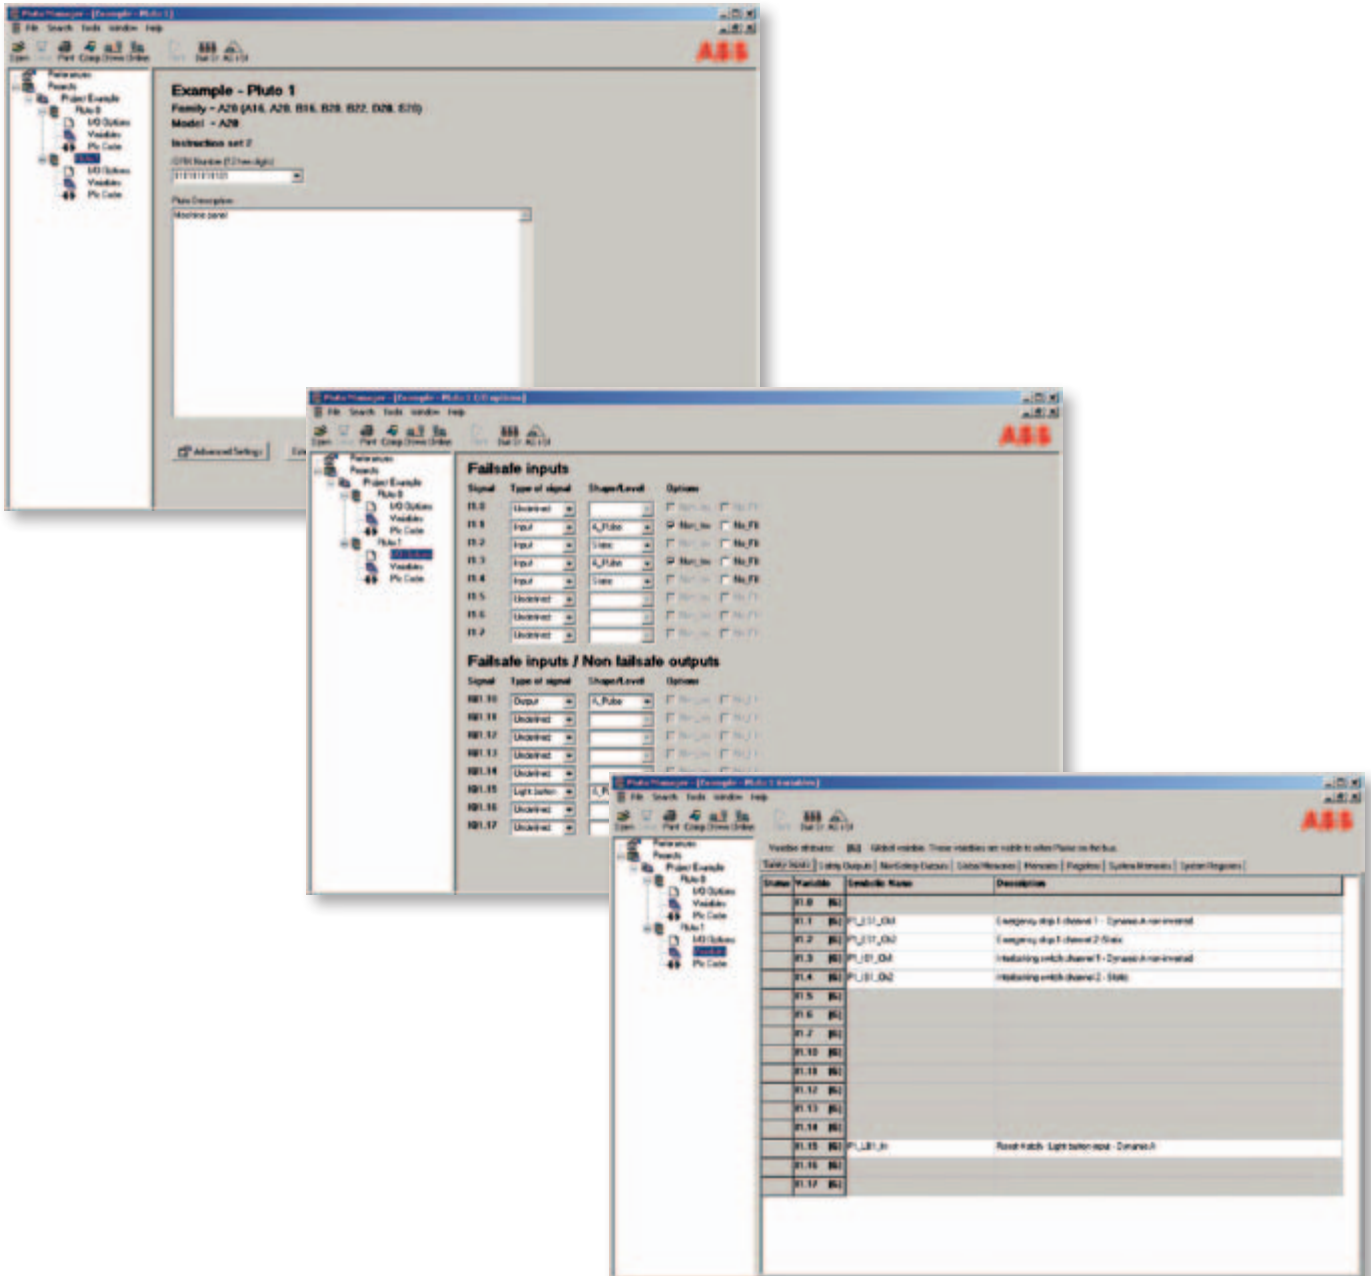

Pluto 1

I1.1=P2_ES1_Ch1

I1.2=P2_ES1_Ch2

I1.3=P2_IS1_Ch1

I1.4=P2_IS1_Ch2

I1.15=P2_LB1_In

Q1.0=P2_ES

Q1.1=P2_PS

GM1.0=P2_ES_OK

GM1.1=P2_Hatch_OK

;Emergency stop 1 channel 1 - Dynamic A non-inverted

;Emergency stop 1 channel 2 -Static

;Interlocking switch channel 1 - Dynamic A non-inverted

;Interlocking switch channel 2 - Static

;Reset Hatch - Light button input - Dynamic A


;Machine Emergency stop

;Machine protective stop

;Emergency stop OK in Pluto 1


;Hatch closed

PLC code Pluto 0 – Robot cabinet

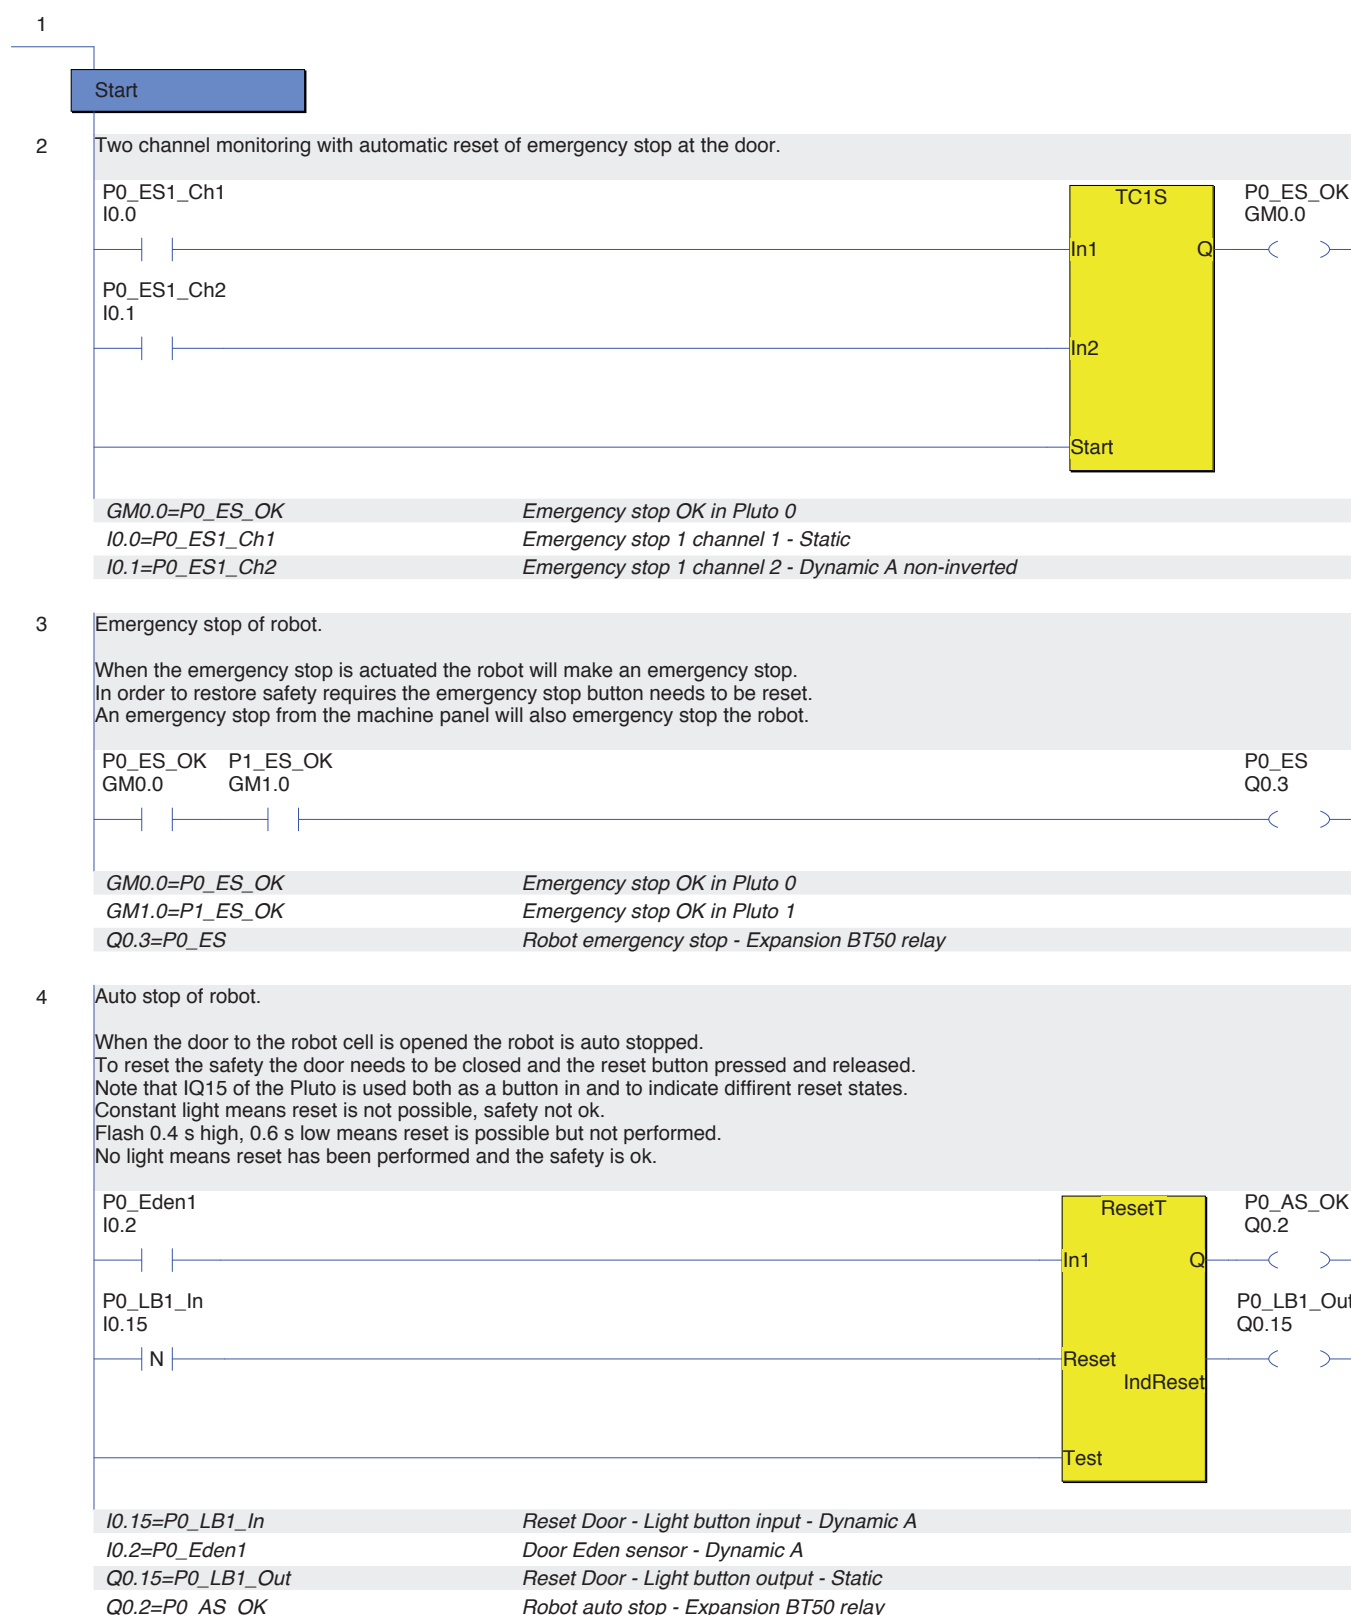


5 Alarm 03 - Machine hatch open.

To generate User Errors (UE) a value of 200 - 299 can be written to the display of the Pluto.
A check of System Register 11 (SR11) in the Pluto prioritises errors from the Pluto itself over User Errors.

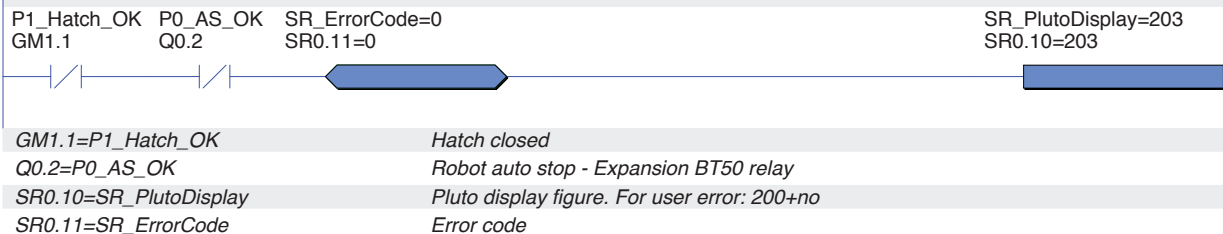


6 Alarm 02 - Door open.

To generate User Errors (UE) a value of 200 - 299 can be written to the display of the Pluto.
A check of System Register 11 (SR11) in the Pluto prioritises errors from the Pluto itself over User Errors.

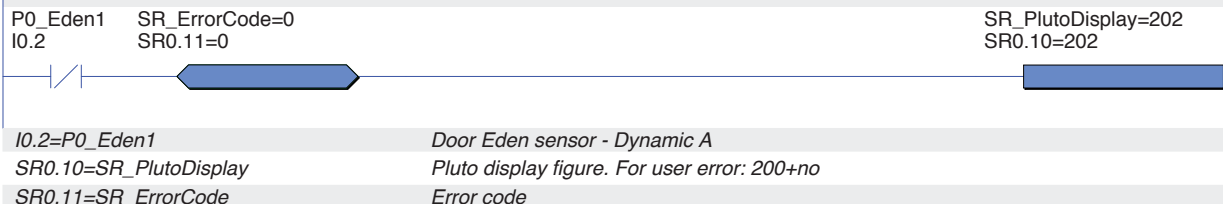


7 Alarm 01 - Emergency stop actuated.

To generate User Errors (UE) a value of 200 - 299 can be written to the display of the Pluto.
A check of System Register 11 (SR11) in the Pluto prioritises errors from the Pluto itself over User Errors.

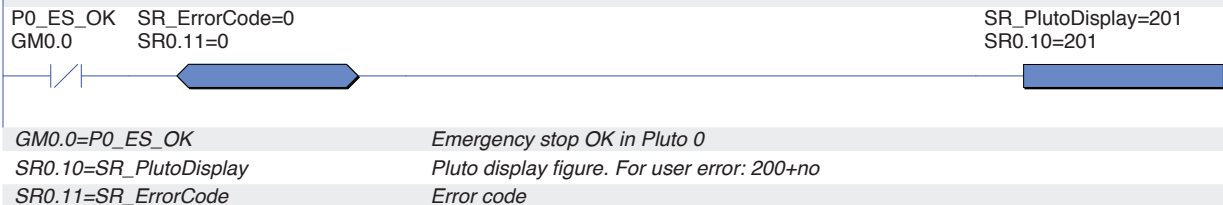

PLC code Pluto 1 – Machine cabinet

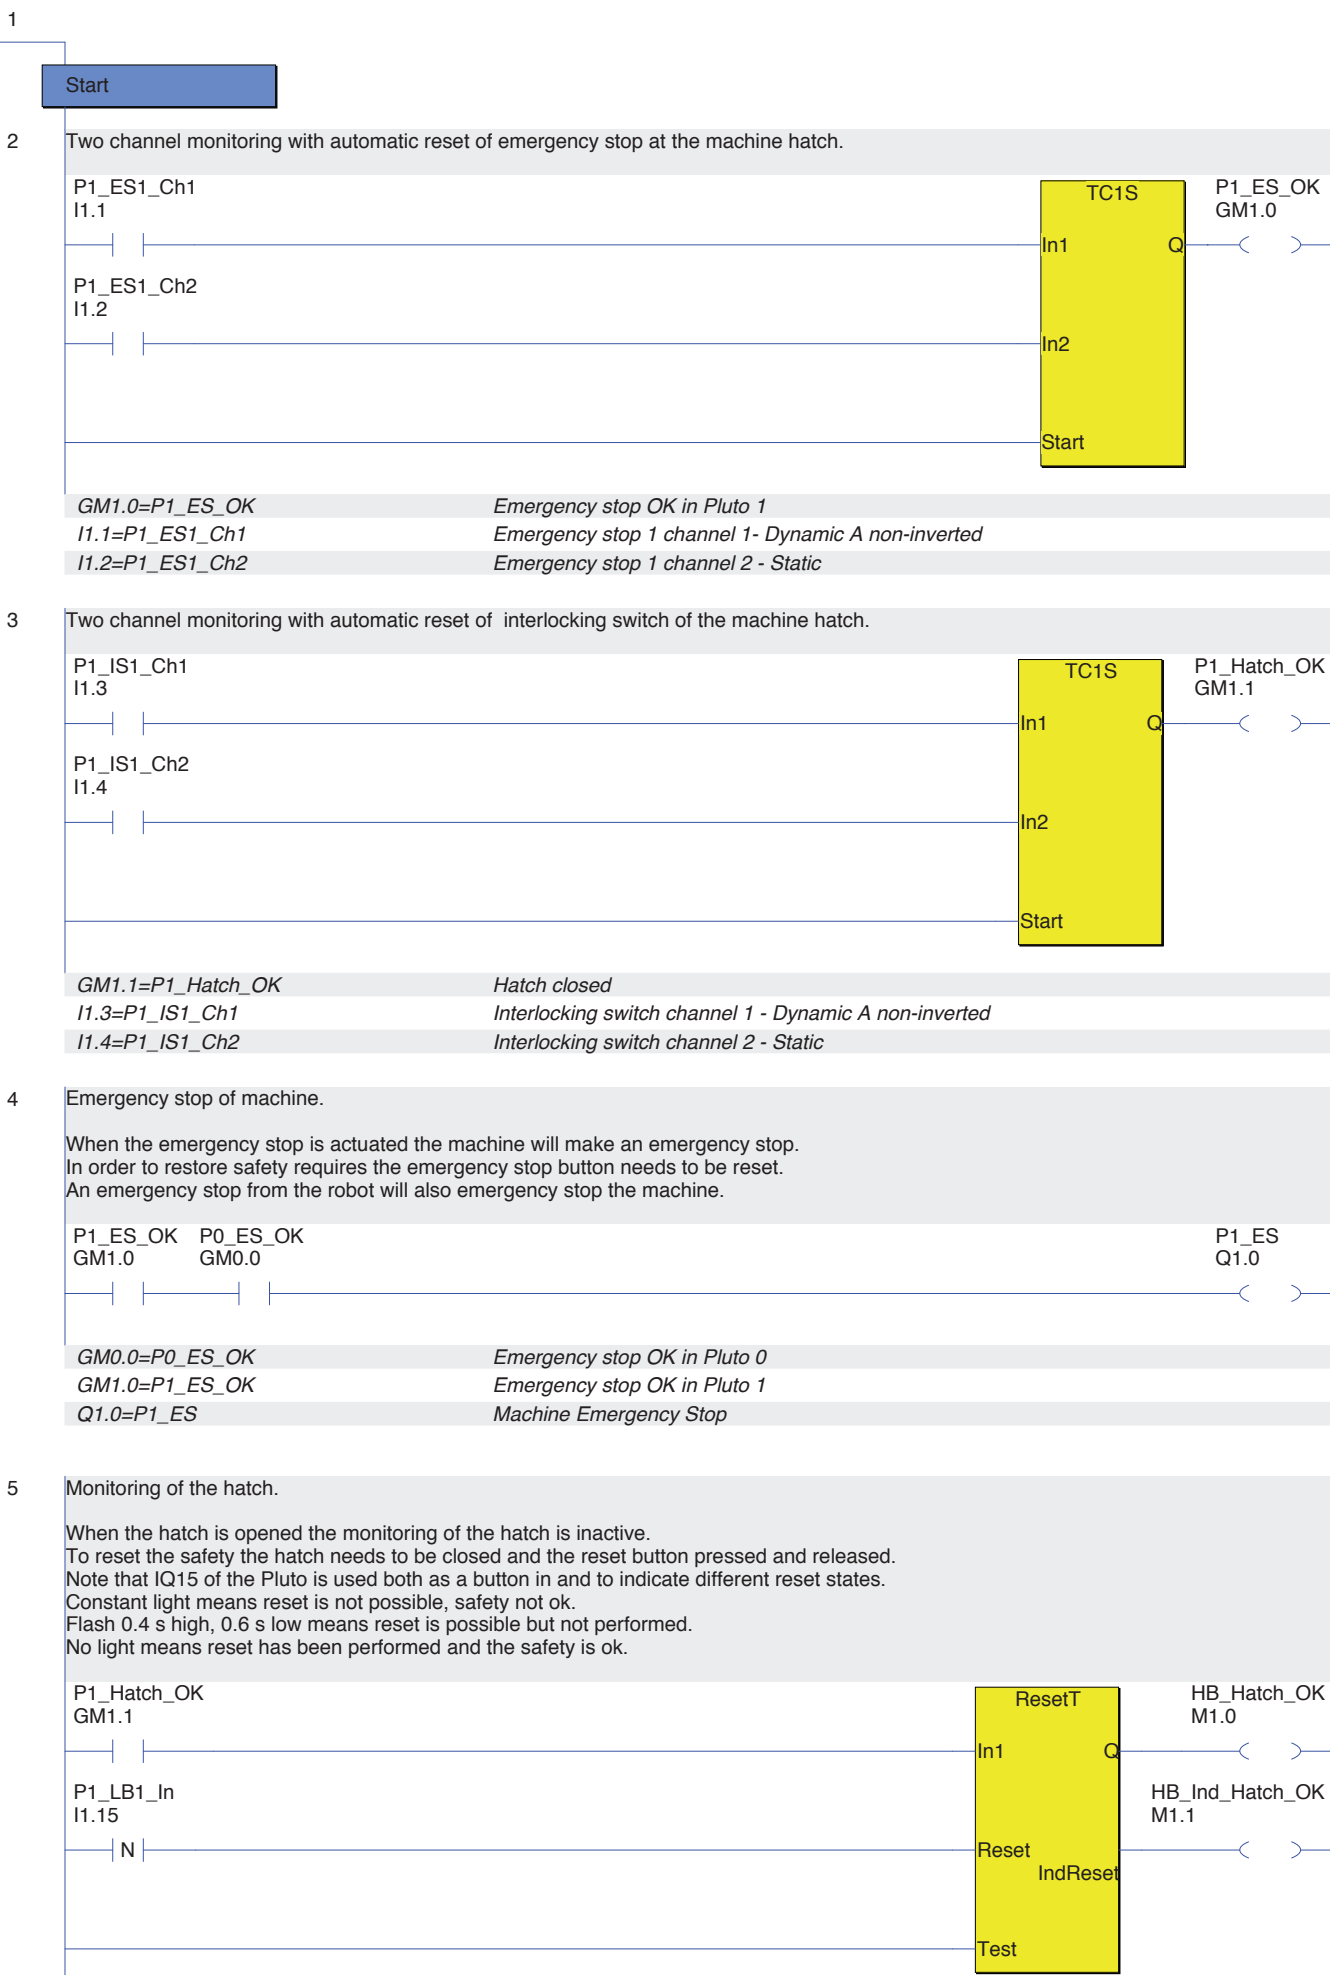

GM1.1=P1_Hatch_OK	Hatch closed
I1.15=P1_LB1_In	Reset Hatch - Light button input - Dynamic A
M1.0=HB_Hatch_OK	Help Bit - Hatch closed
M1.1=HB_Ind_Hatch_OK	Help Bit - Indication Reset Hatch


6 Light button indication of the reset of the hatch.

If the robot cell's door is closed and reset no light indication is needed inside the cell.




7 Protective stop of the machine.

Either the hatch is closed and reset or the door to the robot cell is closed and reset. This means the cell can work with the hatch both open or closed as long as the cell's door is closed and reset.

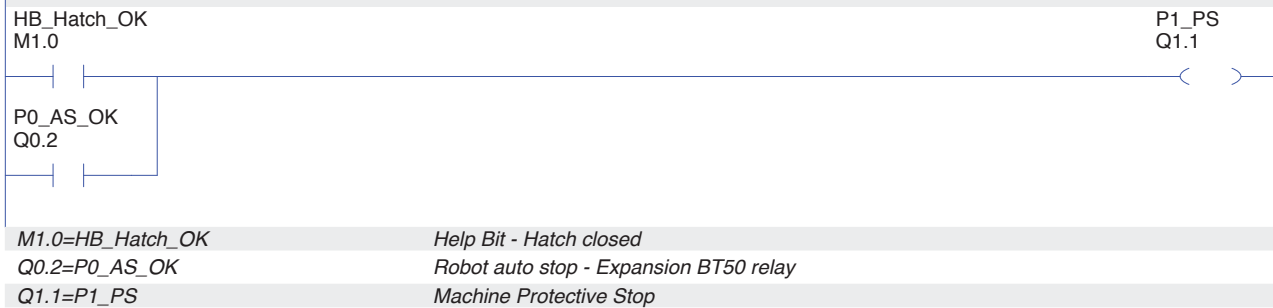


8 Alarm 03 - Machine hatch open.

To generate User Errors (UE) a value of 200 - 299 can be written to the display of the Pluto. A check of System Register 11 (SR11) in the Pluto prioritises errors from the Pluto itself over User Errors.

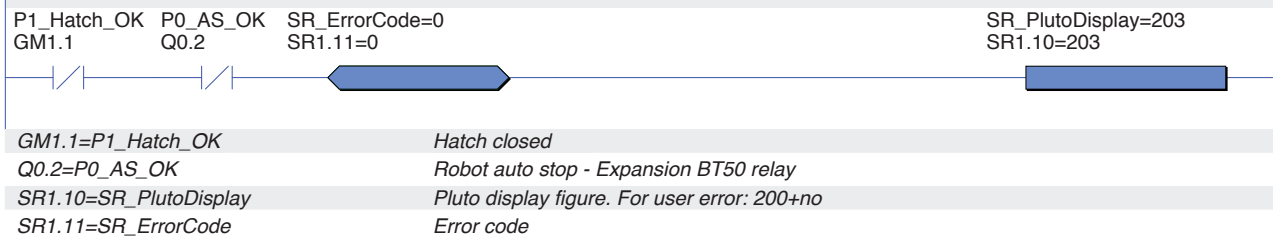


9 Alarm 02 - Door open.

To generate User Errors (UE) a value of 200 - 299 can be written to the display of the Pluto. A check of System Register 11 (SR11) in the Pluto prioritises errors from the Pluto itself over User Errors.

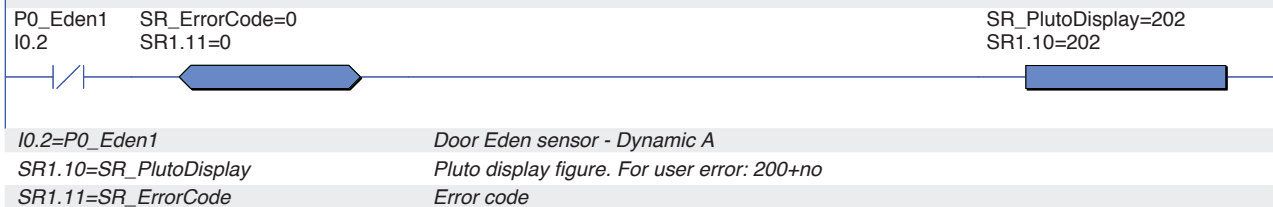

10 Alarm 01 - Emergency stop actuated.

To generate User Errors (UE) a value of 200 - 299 can be written to the display of the Pluto. A check of System Register 11 (SR11) in the Pluto prioritises errors from the Pluto itself over User Errors.

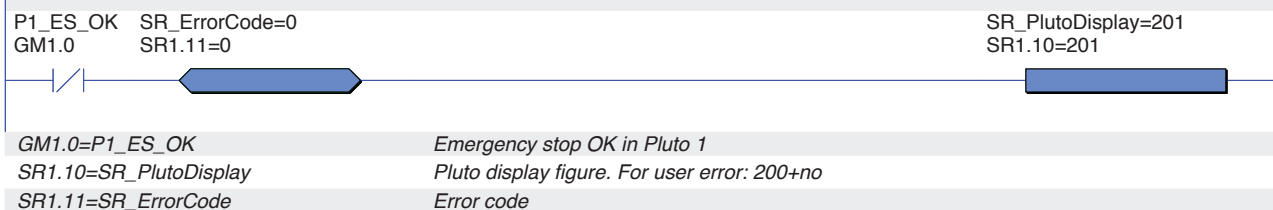

GATE-P2

Use:

Bi-directional status information from the Pluto safety PLC

For Profibus

Features:

Two-way communication

Built-in filter function, shared network

Only 22.5 mm wide

Can be located anywhere in the databus

Common interface with Pluto

Ready-made function blocks

Profibus DP

DeviceNet

CANopen

Profinet

Ethernet/IP

Modbus TCP



Pluto gateway is a unit providing two-way communication between a Pluto safety PLC and other field buses.

The Pluto gateway is a compact unit mounted on a DIN rail, and can be connected anywhere in a Pluto safety bus. The unit has a common interface with Pluto, i.e. the same cabling, and the Pluto Manager PC program can be used for servicing and where necessary programming. Normally, however, all the settings are made via a DIP switches, which means that programming tools are not required to put the gateway itself into operation.

For programming Pluto there are ready-made function blocks which, via a Pluto gateway, send and receive data from the supervisory system.

Data from Pluto

Via PROFIBUS a supervisory PLC system can have access to the I/O and other variables in a Pluto safety PLC. Global I/O in a Pluto safety PLC are accessible via PROFIBUS modules in the gateway, one module for each Pluto unit. Local data in Pluto units can be read by a "local data" module together with the PLC codes in the supervisory system.

Data to Pluto

Via PROFIBUS a supervisory PLC system can transmit non-safety-related information to a Pluto safety PLC. A total of 64 Boolean values and 8 different 16-bit registers can be transmitted. Function blocks for these functions are available in Pluto Manager.


PLC function blocks

To simplify the integration of a Pluto gateway PROFIBUS into the supervisory PLC system, ABB Jokab Safety provides ready-made function blocks for several popular brands of PLC. The function blocks make it easier to receive and send information to the Pluto system. The function blocks are supplied as open units with full access for the customer to change and add functions. These function blocks can be obtained via www.abb.com/lowvoltage.




Technical data - GATE-P2

Manufacturer:	ABB AB/Jokab Safety, Sweden
Article number/ordering data:	2TLA020071R8000 GATE-P2
Databases:	-Pluto safety bus CAN (isolated) -PROFIBUS RS485 (isolated)
Pluto safety bus speeds:	100, 200, 250, 400, 500, 800 and 1000 kbit/s (automatic speed detection)
PROFIBUS speed:	Up to 12 Mbit/s (automatic speed detection)
PROFIBUS address:	Setting via DIP switches (0-99)
PROFIBUS version:	DP slave, DP-V0
Connections:	Top, 3-pole terminal for Pluto safety bus (included) Front, standard 9-pole PROFIBUS connection. Bottom, 2-pole terminal for 24 V DC (included)
Status indication:	Pluto safety bus status indication via LED PROFIBUS status indication via LED
Operating voltage:	24 V DC, -15% till +20%
Current at 24 V:	< 100 mA (recommended fuse ≤ 6 A)
Dimensions (w x h x d):	22.5 x 101 x 119 mm
Installation:	35 mm DIN rail
Operating temperature (ambient):	-10°C to + 55°C
Temperature, transport and storage:	-25°C to + 55°C
Humidity:	EN 60 204-1 50% at 40°C (ambient 90% at 20°C)
Enclosure classification:	Enclosure IP 20 - IEC 60 529 Terminals IP 20 - IEC 60 529

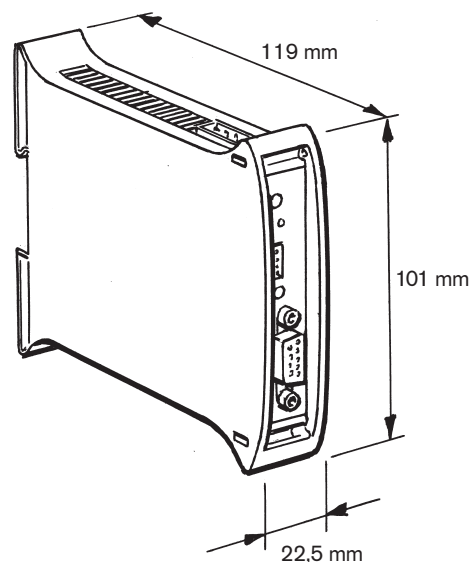

Gateway block schematic diagram - Pluto Profibus

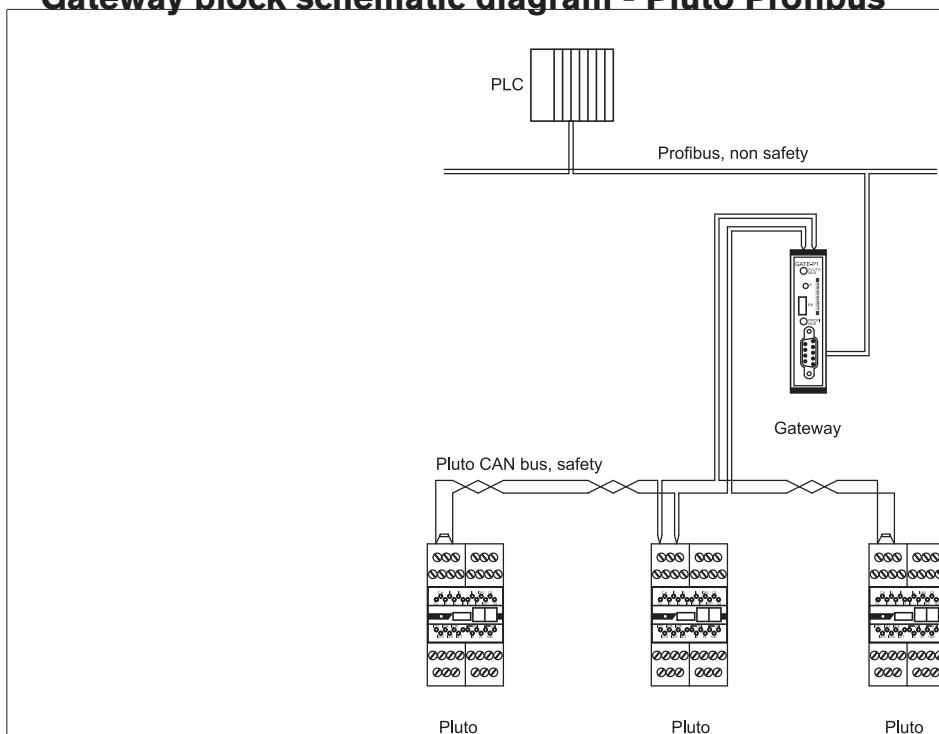

GATE-D2

Profibus DP

DeviceNet

CANopen

Profinet

Ethernet/IP

Modbus TCP



Use:

Bi-directional status information from the Pluto safety PLC

For DeviceNet and Pluto bridge

Features:

Two-way communication

Built-in filter function, shared network

Only 22.5 mm wide

Can be located anywhere in the databus

Common interface with Pluto

Ready-made function blocks

Pluto gateway is a unit providing two-way communication between a Pluto safety PLC and other field buses.

The Pluto gateway is a compact unit mounted on a DIN rail, and can be connected anywhere in a Pluto safety bus. The unit has a common interface with Pluto, i.e. the same cabling, and the Pluto Manager PC program can be used for servicing and where necessary programming. Normally, however, all the settings are made via a DIP switches, which means that programming tools are not required to put the gateway itself into operation.

For programming Pluto there are ready-made function blocks which, via a Pluto gateway, send and receive data from the supervisory system.

Data from Pluto

Via DeviceNet a supervisory PLC system can have access to the I/O and other variables in a Pluto safety PLC. Global I/Os in a Pluto safety PLC are accessible via DeviceNet "implicit" messages. Local data in Pluto units can be read via DeviceNet "explicit" messages.

Data to Pluto

Via DeviceNet a supervisory PLC system can transmit non-safety-related information to a Pluto safety PLC. A total of 64 Boolean values and 8 different 16-bit registers can be transmitted (via DeviceNet "implicit" or "explicit" messages). Function blocks for these commands are available in Pluto Manager.

Pluto bridge

A GATE-D2 can also be used to advantage as a CAN bridge when it is required to divide a Pluto safety bus into

several sections. This is particularly useful when long data-bus cables are needed.

There is also a built-in filter function which makes it possible to block any data that is not required for use on the other side of the bridge, which reduces the databus loading in the other sections and thereby permits longer data-bus cables.


ABB Robotics IRC5

PLUTO GATE-D2 has support for integration into an ABB Robotics IRC5-system. The documentation that describes this integration can be obtained via the www.abb.com/low-voltage.




Technical data - GATE-D2

Manufacturer	ABB AB/Jokab Safety, Sweden
Article number/ordering data:	2TLA020071R8200 GATE-D2
Databuses:	-Pluto safety bus CAN (isolated) -DeviceNet CAN (isolated)
Pluto safety bus speeds:	100, 200, 250, 400, 500, 800 and 1000 kbit/s (automatic speed detection)
DeviceNet speeds:	125, 250 and 500 kbit/s (set via DIP switch)
DeviceNet address:	Setting via DIP switches (1-63)
DeviceNet Version:	ODVA version 2.0
Connections:	Top, 3-pole terminal for Pluto safety bus (included) Front, 5-pole terminal for DeviceNet (included) Bottom, 2-pole terminal for 24 V DC (included)
Status indications:	Pluto safety bus status indication via LED DeviceNet MNS status indication via LED
Operating voltage:	24 V DC, -15% till +20%
Current at 24 V:	< 100 mA (recommended fuse ≤ 6 A)
Dimensions (w x h x d):	22.5 x 101 x 119 mm
Installation:	35 mm DIN rail
Operating temperature (ambient):	-10°C to + 55°C
Temperature, transport and storage:	-25°C to + 55°C
Humidity:	EN 60 204-1 50% at 40°C (ambient 90% at 20°C)
Enclosure classification:	Enclosure IP 20 - IEC 60 529 Terminals IP 20 - IEC 60 529

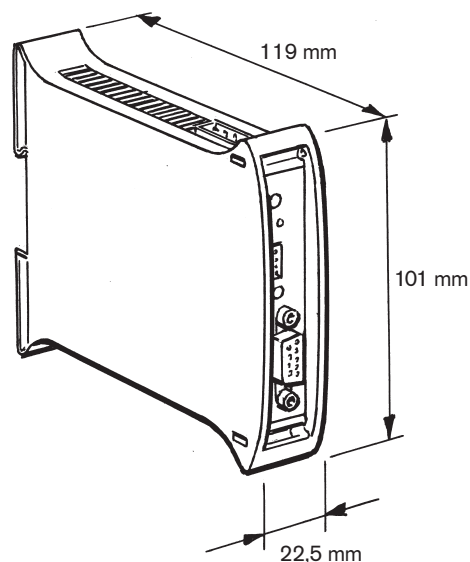

Gateway block schematic diagram - Pluto DeviceNet

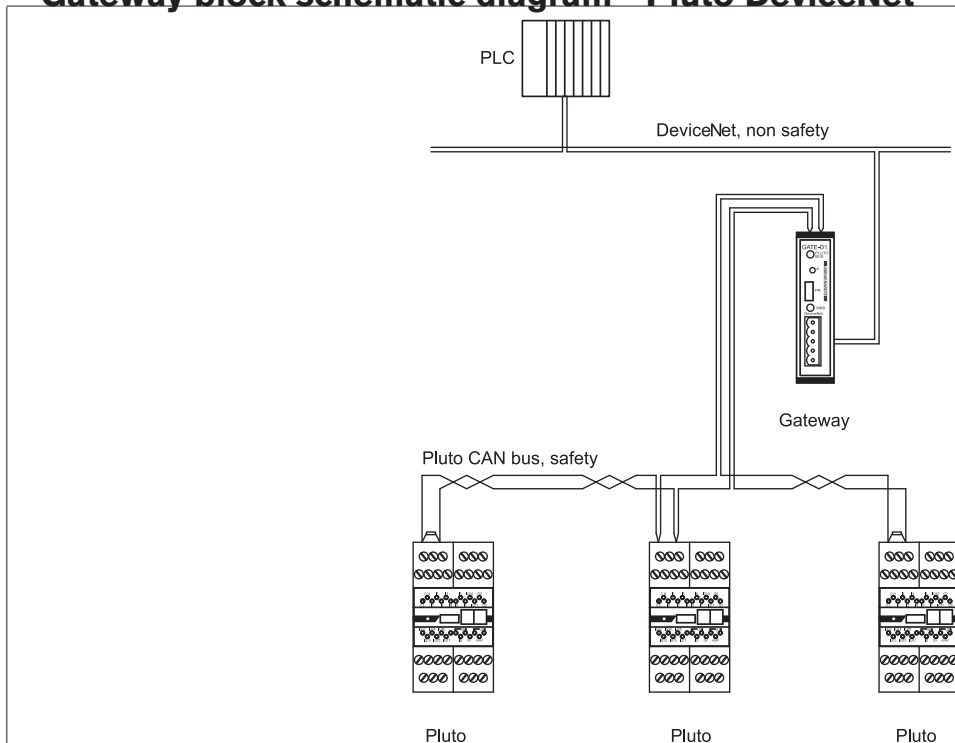

GATE-C2

Profibus DP

DeviceNet

CANopen

Profinet
Ethernet/IP
Modbus TCP



Use:

Bi-directional status information from the Pluto safety PLC

For CANopen and Pluto-bridge

Features:

Two-way communication

Built-in filter function, shared network

Only 22.5 mm wide

Can be located anywhere in the databus

Common interface with Pluto

Ready-made function blocks

Pluto gateway is a unit providing two-way communication between a Pluto safety PLC and other field buses.

The Pluto gateway is a compact unit mounted on a DIN rail, and can be connected anywhere in a Pluto safety bus. The unit has a common interface with Pluto, i.e. the same cabling, and the Pluto Manager PC program can be used for servicing and where necessary programming. Normally, however, all the settings are made via a DIP switches, which means that programming tools are not required to put the gateway itself into operation.

For programming Pluto there are ready-made function blocks which, via a Pluto gateway, send and receive data from the supervisory system.

Data from Pluto

Via CANopen a supervisory PLC system can have access to the I/O and other variables in a Pluto safety PLC. Global I/Os in a Pluto safety PLC are accessible via CANopen PDO messages. Local data in Pluto units can be read via CANopen SDO messages together with the PLC codes in the supervisory system.

Data to Pluto

Via CANopen a supervisory PLC system can send non-safety-related information to a Pluto safety PLC. A total of 64 Boolean values and 8 different 16-bit registers can be transmitted (CANopen PDO or SDO messages). Function blocks for these commands are available in Pluto Manager.

Pluto bridge


A GATE-C2 can also be used to advantage as a CAN bridge when it is required to divide a Pluto safety bus into several sections. This is particularly useful when long databus cables are needed.

There is also a built-in filter function which makes it possible to block any data that is not required for use on the other side of the bridge, which reduces the databus loading in the other sections and thereby permits longer databus cables.




Technical data - GATE-C2

Manufacturer	ABB AB/Jokab Safety, Sweden
Article number/ordering data:	2TLA020071R8100 GATE-C2
Databuses:	-Pluto safety bus CAN (isolated) -CANopen CAN (isolated)
Pluto safety bus speeds:	100, 200, 250, 400, 500, 800 and 1000 kbit/s (automatic speed detection)
CANopen speeds:	125, 250 and 500 kbit/s (set via DIP switch) 10, 20, 50, 100, 125, 250, 500, 800 and 1000 kbit/s (via software)
CANopen address:	Setting via DIP switches or software (1-63)
CANopen version:	"Version 4.02 of the CiA Draft Standard 301"
Connections:	Top, 3-pole terminal for Pluto safety bus (included) Front, 5-pole terminal for CANopen (included) Bottom, 2-pole terminal for 24 V DC (included)
Status indications:	Pluto safety bus status indication via LED CANopen status indication via LED
Operating voltage:	24 V DC, -15% till +20%
Current at 24 V:	< 100 mA (recommended fuse ≤6 A)

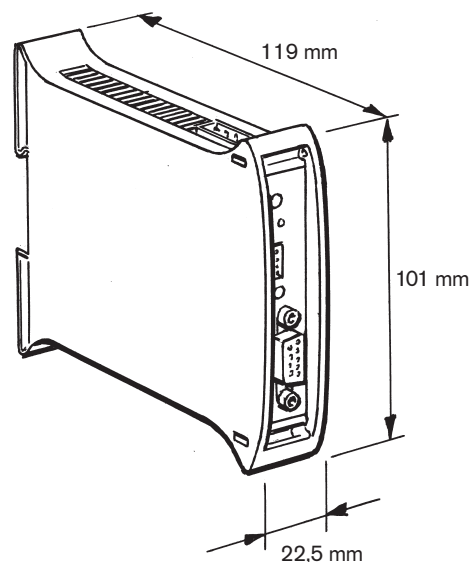

Dimensions (w x h x d):	22.5 x 101 x 119 mm
Installation:	35 mm DIN rail
Operating temperature (ambient):	-10°C to + 55°C
Temperature, transport and storage:	-25°C to + 55°C
Humidity:	EN 60 204-1 50% at 40°C (ambient 90% at 20°C)
Enclosure classification:	Enclosure IP 20 - IEC 60 529 Terminals IP 20 - IEC 60 529

Gateway block schematic diagram - Pluto CANopen

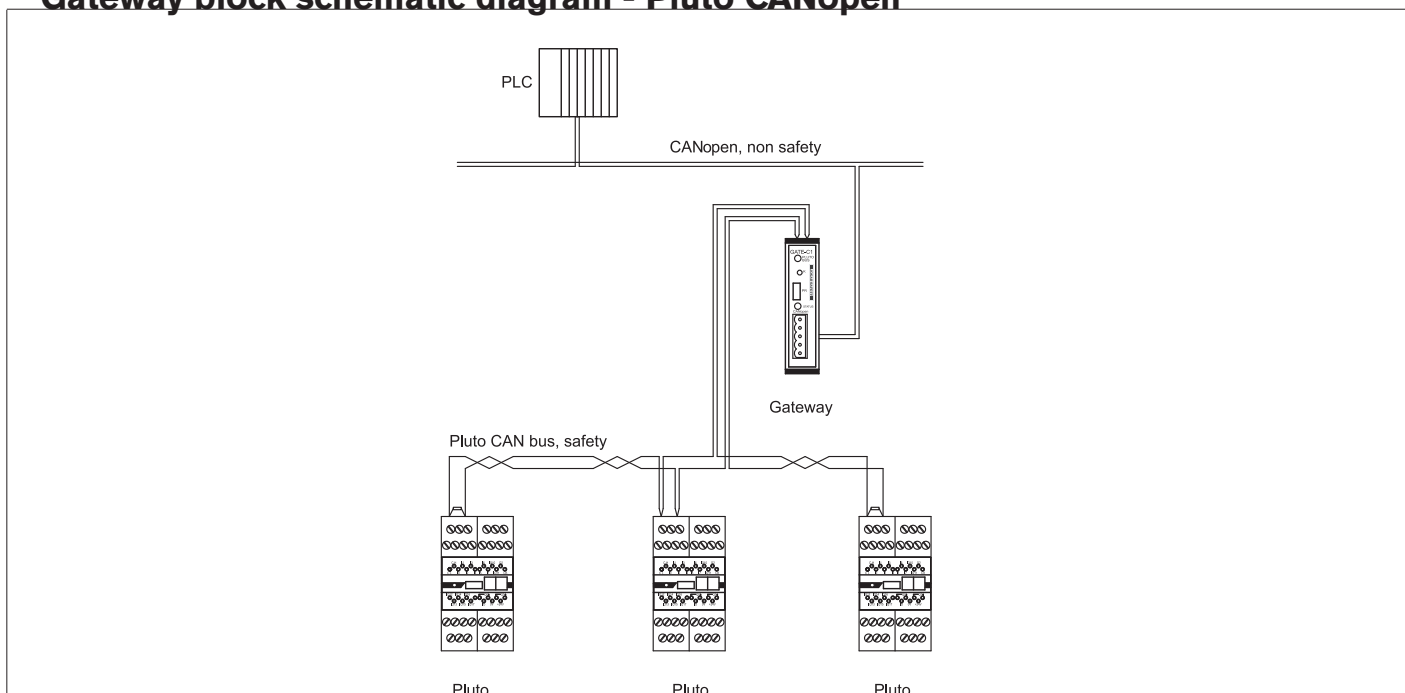

Pluto gateway

GATE-E2

Profibus DP

DeviceNet

CANopen

Profinet

Ethernet/IP

Modbus TCP



Use:

Bi-directional status information from the Pluto safety PLC

Profinet, Ethernet/IP, Modbus TCP

Features:

Two-way communication

Built-in filter function, shared network

Can be located anywhere in the databus

Common interface with Pluto

Ready-made function blocks

Pluto gateway is a unit providing two-way communication between a Pluto safety PLC and other field buses.

The Pluto gateway is a compact unit mounted on a DIN rail, and can be connected anywhere in a Pluto safety bus. The unit has a common interface with Pluto, i.e. the same cabling, and the Pluto Manager PC program can be used for servicing and where necessary programming. Normally, however, all the settings are made via a DIP switches, which means that programming tools are not required to put the gateway itself into operation.

For programming Pluto there are ready-made function blocks which, via a Pluto gateway, send and receive data from the supervisory system.

Protocol

PLUTO Gateway GATE-E2 handles the status from and to Pluto safety PLCs via Ethernet protocols EtherNet/IP, PROFINET, Modbus TCP and a simple binary protocol that uses TCP/IP.


For IP-address configuration, etc. there is a simple web server and a terminal server.

Data from Pluto

Via one of the Ethernet protocols a supervisory PLC system can have access to the I/O and other variables in a Pluto safety PLC. Global I/Os in a Pluto safety PLC are accessible via the usual I/O transfer in the respective protocol. Local data in Pluto units can be read by special commands together with the PLC codes in the supervisory system.

Data to Pluto



Via the Ethernet protocol a supervisory PLC system can transmit non-safety-related information to a Pluto safety PLC. A total of 64 Boolean values and 8 different 16-bit registers can be transmitted. Function blocks for these functions are available in Pluto Manager.

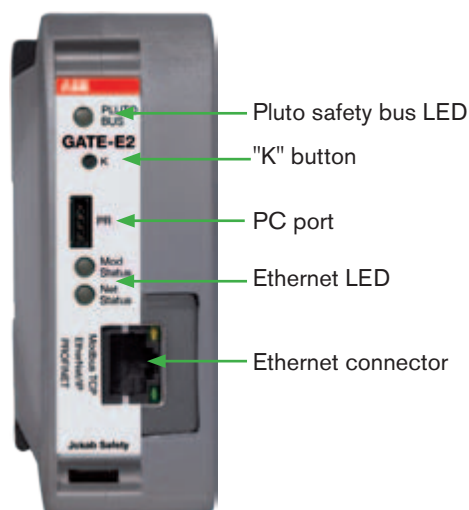

Technical data - GATE-E2	
Manufacturer	ABB AB/Jokab Safety, Sweden
Article number/ ordering data:	2TLA020071R8300 GATE-E2
Buses:	Pluto-bus CAN (isolated) Profinet (isolated) Ethernet/IP (isolated) Modbus TCP (isolated)
Pluto safety bus speeds	100, 200, 250, 400, 500, 800 and 1000 kbit/s (automatic speed detection)
Ethernet	10/100 Mbit/s Half and full duplex
Ethernet protocol	Status from and to Pluto safety PLC - EtherNet/IP - PROFINET - Modbus TCP - Binary server (TCP/IP) Note that certain combinations of server protocols cannot be used simultaneously. Gateway status and IP address configuration - Web server - Terminal server (TCP/IP)
EtherNet/IP	According to ODVA "CIP Edition 3.2" and "EtherNet/IP Adaption of CIP Edition 1.3". Minimum RPI of 50 ms
PROFINET	PROFINET
Modbus TCP	According to the Modbus organisation, version 1.0b (approx. 20 messages per second).
Binary server (TCP/IP)	Simple TCP/IP protocol to send status from/to the Pluto system.

Web server	For simple sharing of IP addresses.
Terminal server (TCP/IP)	Simple server with the same commands as via the serial programming port in the unit.
IP address	Static sharing via web server or via programming port.
Gateway configuration	Takes place via EtherNet/IP, PROFINET, Modbus TCP or via the binary TCP/IP server.
Connections	Top, 3-pole terminal for Pluto safety bus (included) Front, Ethernet connection via RJ-45 (screened cable cat. 5e FTP) Bottom, 2-pole terminal for 24 V DC (included)
Status indications	Pluto safety bus status indication via LED (Pluto safety bus) Ethernet module status indication via LED (Mod Status) Ethernet network status indication via LED (Net Status)
Operating voltage	24 V DC, -15 % till +20 %
Current at 24 V	< 150 mA (recommended fuse ≤6 A)
Dimensions (w x h x d):	35 x 101 x 120 mm
Installation	35 mm DIN rail
Operating temperature (ambient)	-10°C to + 55°C
Temperature, transport and storage	-25°C to + 55°C
Humidity	EN 60 204-1 50 % at 40°C (ambient 90 % at 20°C)
Enclosure classification	Enclosure IP 20 - IEC 60 529 Terminals IP 20 - IEC 60 529

Gateway block schematic diagram - Pluto Ethernet

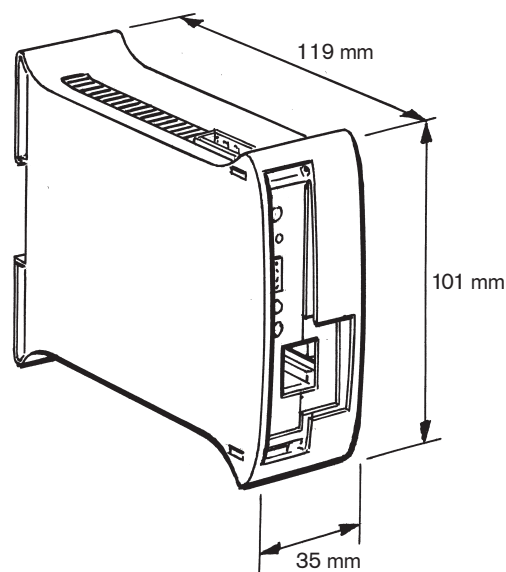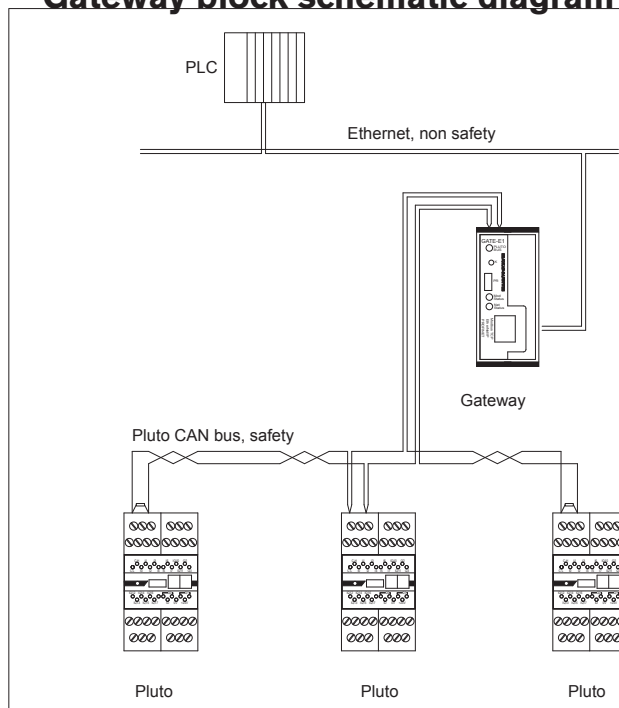

Pluto

Safe Encoder

Use:

Safe position and speed determination of machine movements.

Features:

- High resolution
- Selectable resolution
- Connected directly to the Pluto safety bus
- Ready-made function blocks




Rotational absolute value sensor for safe positioning

Together with a Pluto safety PLC, this rotational absolute encoder can be used for safe position determination. This is particularly useful in the case of such equipment as gantry robots, industrial robots, etc. Also in eccentric shaft presses, existing cam mechanisms can be replaced by absolute value position sensors for safe positioning. The sensors are available in single and multi-turn versions.

Up to 16 absolute encoders can be connected to a Pluto CAN databus. A Pluto on the databus reads the sensor values, which are evaluated. With a special function block in the PLC code, it is possible to design two-channel solutions with the sensors. The user can obtain safe values for position and speed from these values. This enables supervision of stationary and overspeed conditions.

The absolute value sensors are standard sensors with modified software to meet the safety requirements.

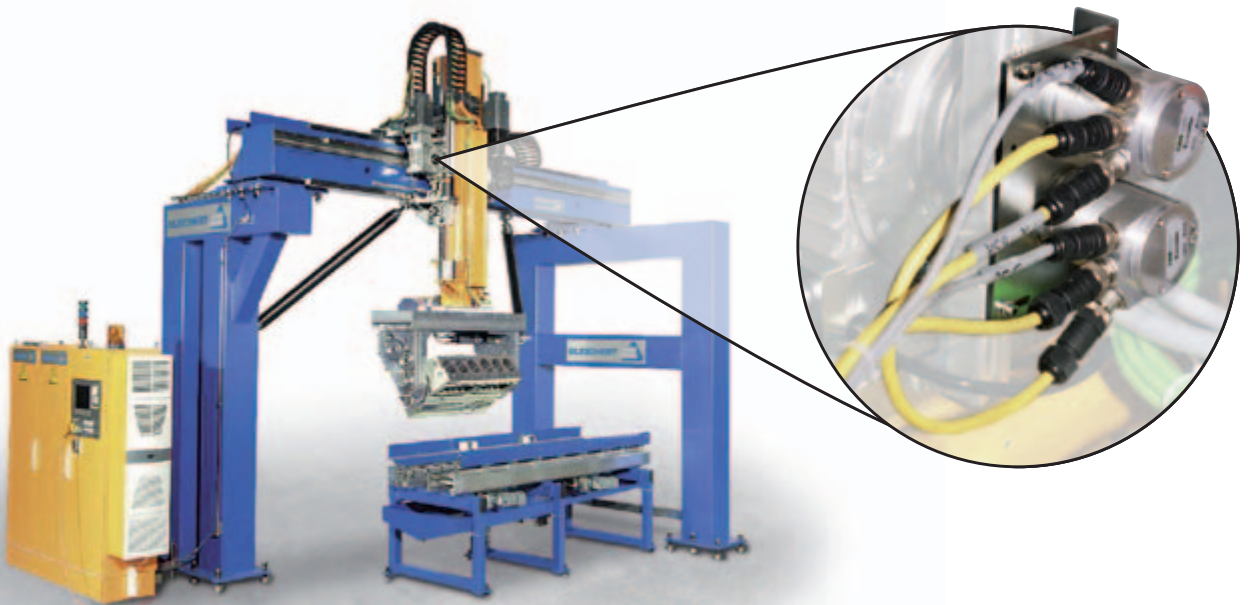


Example of an application where 2 sensors provide safe position determination in a gantry robot.

Technical data – Safe Encoder RSA 597

Manufacturer	ABB AB/Jokab Safety, Sweden
Article number/ordering data:	2TLA020070R3600 RSA 597
Ambient temperature	-40°C .. +70°C
Temperature, transport and storage	-30°C .. +70°C
Ingress protection class	IP-67 in accordance with IEC 60529
At shaft inlet	IP-66 in accordance with IEC 60529
Vibration (55 to 2000 Hz)	< 300 m/s ² in accordance with IEC 60068-2-6
Shock (6ms)	< 2,000 m/s ² in accordance with IEC 60068-2-27
Material, enclosure	Aluminium
Surface treatment	Painted and chromed or anodised
Weight	Approx. 300 g
Accuracy and resolution	
Resolution	13 bits, 8192 positions per rotation
Accuracy	± ½ LSB (Least Significant Bit)
Operating voltage	9-36 V dc
Polarity-protected	Yes
Short-circuit protected	Yes
Databus speed	5 kbit/s - 1 Mbit/s, preset at 500kbit/s
Address input	Active low
Code type	Binary
Programmable functions	Resolution, 0 position Direction, Databus speed
Current consumption	50 mA at 24V dc
Max current consumption	100 mA



Safe Encoder RSA 597 – single turn



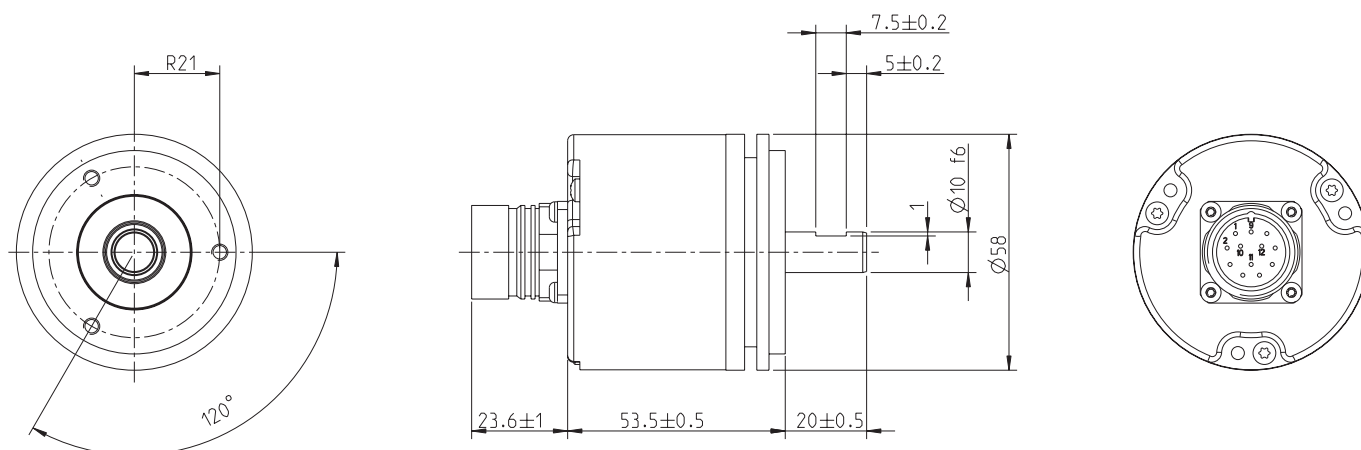


Technical data – Safe Encoder RSA 698

Manufacturer	ABB AB/Jokab Safety, Sweden
Article number/ordering data:	2TLA020070R3700 RSA 698
Ambient temperature	-40°C .. +70°C
Temperature, transport and storage	-30°C .. +70°C
Ingress protection class	IP-67 in accordance with IEC 60529
At shaft inlet	IP-66 in accordance with IEC 60529
Vibration (55 to 2000 Hz)	< 100 m/s ² in accordance with IEC 60068-2-6
Shock (6ms)	< 2,000 m/s ² in accordance with IEC 60068-2-27
Material, enclosure	Aluminium
Surface treatment	Anodised
Weight	Approx. 400g
Accuracy and resolution	
Resolution, total	25 bit 13 bits, 8192 positions per rotation 12 bits, 4096 rotations
Accuracy	± 1 LSB (Least Significant Bit)
Operating voltage	9-36 V dc
Polarity-protected	Yes
Short-circuit protected	Yes
Databus speed	10 kbit/s - 1 Mbit/s
Code type	Binary
Programmable functions	Resolution, 0 position
Current consumption	50 mA at 24V dc
Max current consumption	100 mA



Safe Encoder RSA 698 – multi turn

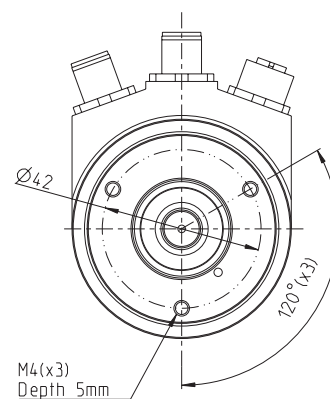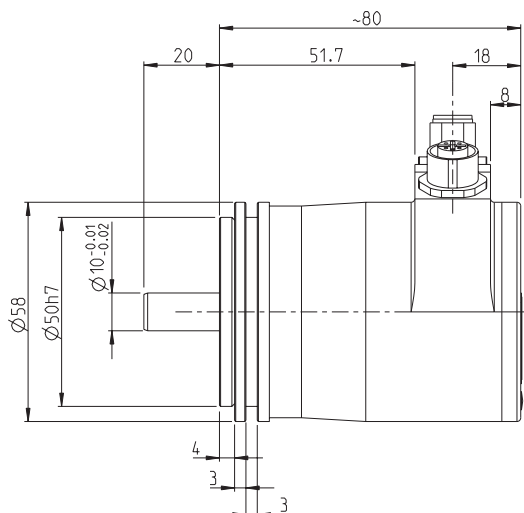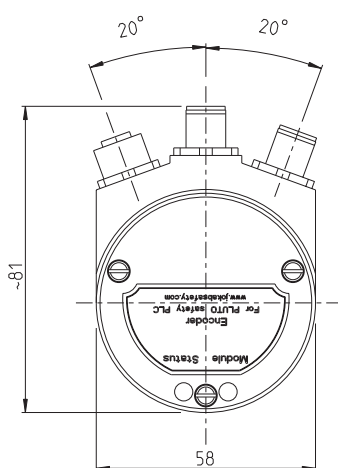


Safe Encoder

Function block for a single-turn encoder that generates safe position and speed values from two absolute encoders.

Function

The block reads and evaluates one absolute encoders. The position value is sent to the 'Position' output. The 'Speed' output is the average value for the speed, at the rate of pulses/10 ms. If an error occurs, the 'OK' output is set to zero. In certain applications the values of 'Position' and 'Speed' are used in conjunction with the 'OK' output.

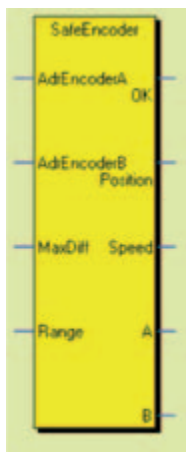

Descriptions of inputs and outputs

- AdrEncoderA: Encoder A node address
- AdrEncoderB: Encoder B node address
- MaxDiff: Max allowed deviation between the encoders (max 2% of Range)
- Range: Number of increments per revolution
- OK: Set when encoders are working OK and the position values are within the margin set by 'MaxDiff'
- Position: Position value
- Speed: Speed value as increments/10ms
- A: Encoder A position. Must not be used in PLC program!
- B: Encoder B position. Must not be used in PLC program!

NOTE! Position values from single encoders are only available for adjustment purposes and must NOT be used for safety.

NOTE! When error occurs 'Position' = -1, 'Speed' = -32768 and the OK output will be reset.

Safe Encoder Multiturn

Function block for a multi-turn encoder that generates safe position and speed values from two absolute encoders. Operative system 2.4.4 or higher is required.

Function

The block reads and evaluates two absolute encoders. The average value for the two sensors is calculated and sent to the 'Position' output. The 'Speed' output is the average value for the speed, at the rate of pulses/10 ms. The block monitors that the encoder position values do not differ by more than the input value set by 'MaxDiff'. If an error occurs, the 'OK' output is set to zero. In certain applications the values of 'Position' and 'Speed' are used in conjunction with the 'OK' output.



Descriptions of inputs and outputs

- AdrEncoderA: Encoder A node address
- AdrEncoderB: Encoder B node address
- MaxDiff: Max allowed deviation between the encoders (max 2% of IncrPerRev)
- IncrPerRev: Number of increments per revolution
- OK: Set when encoders are working OK and the position values are within the margin set by 'MaxDiff'
- Position: Position value
- Speed: Speed value as increments/10ms
- A: Encoder A position. Must not be used in PLC program!
- B: Encoder B position. Must not be used in PLC program!

NOTE! Position values from single encoders are only available for adjustment purposes and must NOT be used for safety.

NOTE! When error occurs 'Position' = -1, 'Speed' = -32768 and the OK output will be reset.

Encoder Cam


Function block for electronic cam gear.

Function

Output Q is activated if the value of the input register 'PosReg' is within the limits for 'MinPos' and 'MaxPos'.

NOTE! It is possible to specify a value that defines the sensor's zero position. Position <0 is not permitted.

Example: If MinPos = 3000 and MaxPos = 200, Q is activated when the position is greater than 2999 or less than 201.



Descriptions of inputs and outputs

- PosReg: Input for the position value
- MinPos: Minimum limit value
- MaxPos: Maximum limit value